




## Ground source heat pump

# NIBE F1355

**NIBE F1355 is an intelligent and powerful invertercontrolled ground source heat pump in two sizes. NIBE F1355 provides optimum savings since the heat pump always performs efficiently and automatically adapts to the property's output requirements all year round.**

NIBE F1355 has a high seasonal performance factor and an operating range of 4–28 kW or 6–45 kW. With less than 5 tonnes CO<sub>2</sub> equivalent refrigerant volume per refrigeration module, NIBE F1355 does not require annual inspection. Two compressors provide efficient output regulation and high reliability, making NIBE F1355 perfect for properties with larger heating requirements.

Thanks to smart technology, the product gives you control over your energy consumption and will be a key part of your connected lifestyle. The efficient control system automatically adjusts the indoor climate for maximum comfort, and you do nature a favour at the same time.




- **Powerful invertercontrolled ground source heat pump in two sizes. Master/Slave compatible in combination with NIBE F1355.**
- **Efficient output regulation and high reliability for larger heating requirements.**
- **Smart technology with user-friendly control for easy remote control.**

# This is how F1355 works

## Installation method



### Rock

F1355 collects a proportion of the rock's stored solar energy via a collector in a borehole in the rock.

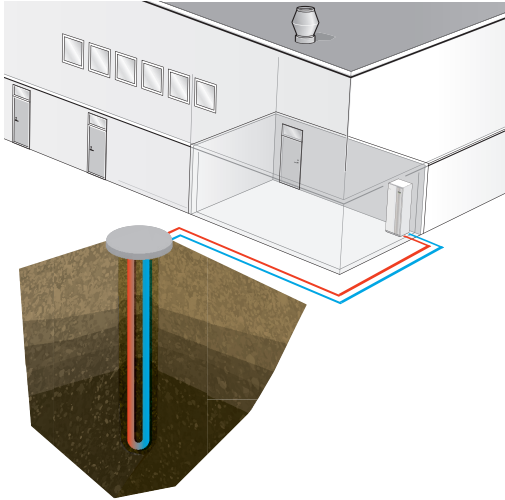


### Lake

F1355 collects a proportion of the water's stored solar energy via a lake collector that is anchored on the lake bed.

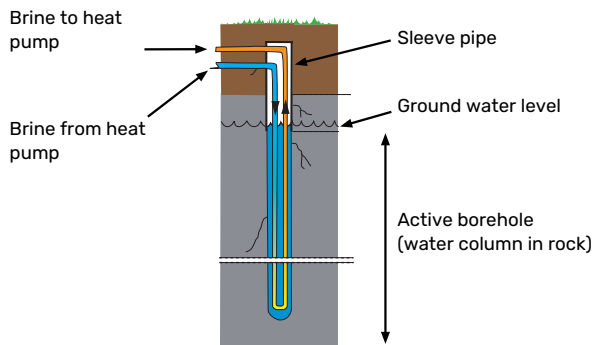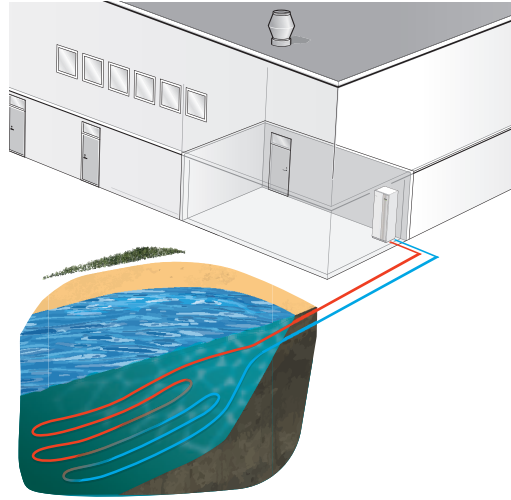


### Ventilation recovery

F1355 collects energy from the ventilation air via an air conditioning unit.

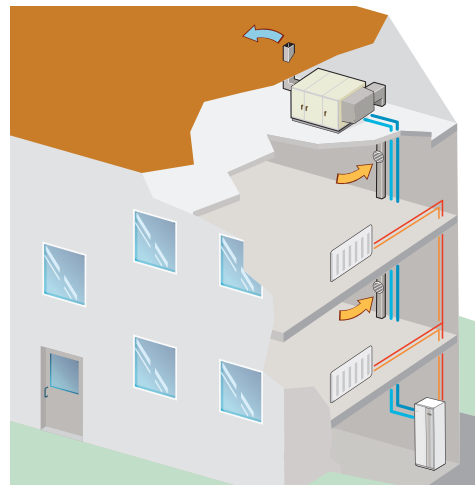

### Ground

F1355 collects a proportion of the ground's stored solar energy via a buried ground collector.

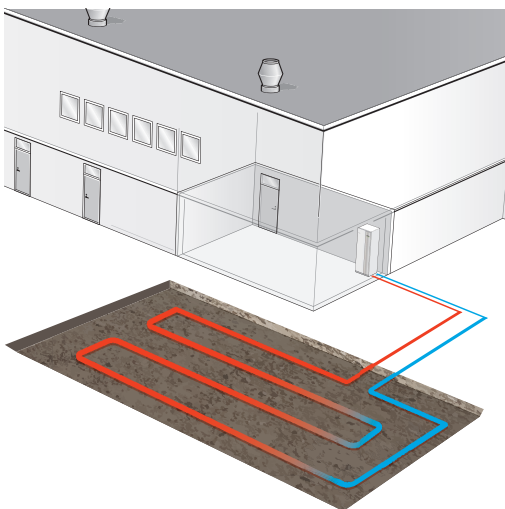


## Design

F1355 is constructed on a robust frame with durable panels and effective soundproofing for the best possible comfort. All panels are easy to remove to facilitate installation and for any servicing.

## Principle of operation

F1355 consists of two heat pump modules, circulation pumps and control system with possibility of additional heat. F1355 is connected to the brine and heating medium circuits.

In the heat pump evaporator, the brine (water mixed with anti-freeze, glycol or ethanol) releases its energy to the refrigerant, which is vaporised in order to be compressed in the compressor. The refrigerant, of which the temperature has now been raised, is passed to the condenser where it gives off its energy to the heating medium circuit and, if necessary, to any docked water heater. If there is a greater need for heating/hot water than the compressors can provide it is possible to connect an external immersion heater.

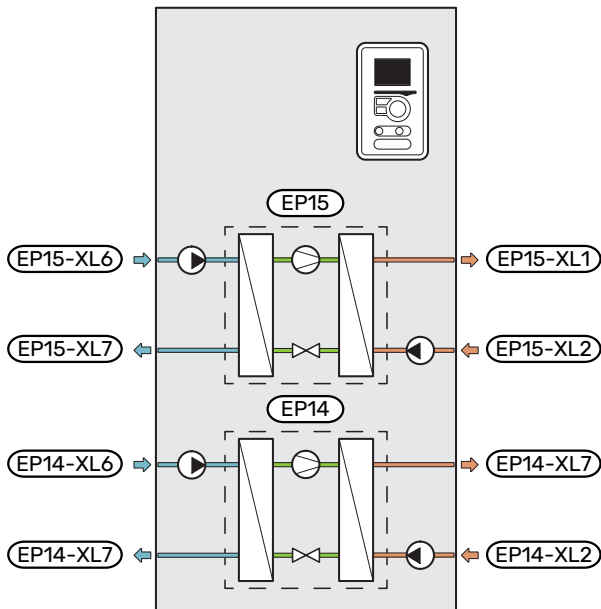

|      |                                   |
|------|-----------------------------------|
| EP14 | Cooling module                    |
| EP15 | Cooling module                    |
| XL1  | Connection, heating medium flow   |
| XL2  | Connection, heating medium return |
| XL6  | Connection, brine in              |
| XL7  | Connection, brine out             |

# Good to know about F1355


## Transport and storage

F1355 should be transported and stored vertically in a dry place. When being moved into a building, F1355 may be leant back 45 °.

The product can be tail heavy.

If the cooling modules are pulled out and transported up-right, F1355 can be transported on its back.

Remove the outer panels in order to protect them when moving in confined spaces inside buildings.

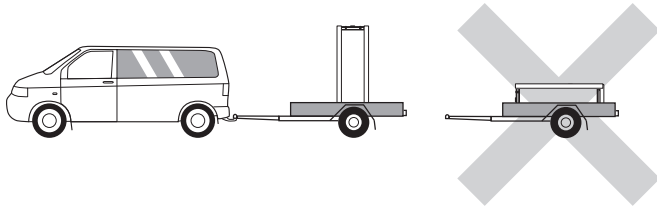

## EXTRACTING THE COOLING MODULES

To simplify transport and service, the heat pump can be separated by pulling the cooling modules out from the cabinet.


See section "Service" in the Operating Manual for comprehensive instructions about the separation.

## Installation and positioning

- Place F1355 on a solid foundation indoors that can take the heat pump's weight.
- Because water comes from F1355, the area where the heating pump is located must be equipped with floor drainage.
- Install with its back to an outside wall, ideally in a room where noise does not matter, in order to eliminate noise problems. If this is not possible, avoid placing it against a wall behind a bedroom or other room where noise may be a problem.
- Wherever the unit is located, walls to sound sensitive rooms should be fitted with sound insulation.
- Route pipes so they are not fixed to an internal wall that backs on to a bedroom or living room.

## INSTALLATION AREA


Leave a free space of 800 mm in front of, and 150 mm above, the product. Approx. 50 mm free space is required on each side, to allow the side panels to be removed (see image). All service on F1355 can be carried out from the front, although the right-hand panel may need to be removed. Leave space between the heat pump and the wall behind (and any routing of supply cables and pipes), to reduce the risk of any vibration being propagated.

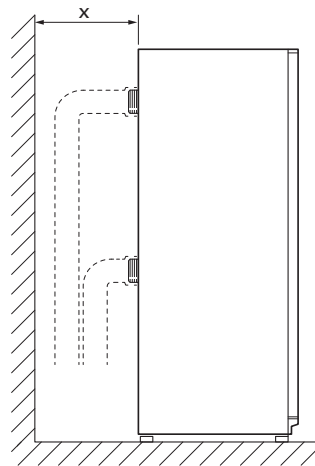

x Leave the required space for pipe installation.

## Supplied components


Local differences in the enclosed kit may occur. See relevant installer manual for more information.



Outdoor temperature sensor  
1 pcs



Temperature sensor  
5 pcs




Insulation tape  
1 pcs



Aluminium tape  
1 pcs



Heat conduction paste  
3 pcs



Safety valve  
0.3 MPa (3 bar)  
1 pcs




O-rings  
16 pcs




Current sensor  
3 x



Tubes for sensors  
4 pcs



Pipe insulation  
8 pcs



Cable ties  
8 pcs



Non-return valves  
28 kW: 4 pcs G2  
(internal thread)  
43 kW: 4 pcs G2  
(internal thread)



Filterball  
28 kW: 4 pcs G1 1/4  
(internal thread)  
43 kW: 2 x G1 1/4  
(internal thread), 2  
x G2 (internal  
thread)

### LOCATION

The enclosed kit is placed in the packaging next to the heat pump.

# Installation

## Inspection of the installation

Current regulations require the heating installation to be inspected before it is commissioned. The inspection must be carried out by a suitably qualified person.

## Pipe installation

Pipe installation must be carried out in accordance with current standards and directives. F1355 can operate with a return temperature of up to 58 °C and an outgoing temperature of 65 °C.

F1355 is not equipped with internal shut-off valves; instead, these should be installed to facilitate any future servicing. In addition, non-return valves and particle filters must be fitted.

The pipe connections are on the rear of the heat pump.

Water may drip from the safety valve's overflow pipe. The overflow pipe must be routed to a suitable drain, so hot water splashes cannot cause harm. The entire length of the overflow pipe must be inclined to prevent water pockets, and must also be frost-proof. The overflow pipe must be at least the same size as the safety valve. The overflow pipe must be visible and its mouth must be open and not placed close to electrical components.

## BRINE



The brine transports energy from a source to the heat pump using a liquid consisting of water mixed with antifreeze.

## Expansion vessel


The brine circuit must be supplied with a pressure expansion vessel.

The brine side must be pressurised to at least 0.05 MPa (0.5 bar).

Dimension the pressure expansion vessel in accordance with the following diagram to prevent malfunctions. The diagrams cover the temperature range from -10 °C to +20 °C at pre-pressure 0.05 MPa (0.5 bar) and the safety valve's opening pressure of 0.3 MPa (3.0 bar).


## Ethanol 28% (volume percent)

In installations with ethanol (28% volume percent) as the brine the pressure expansion vessel must be dimensioned according to the following diagram.

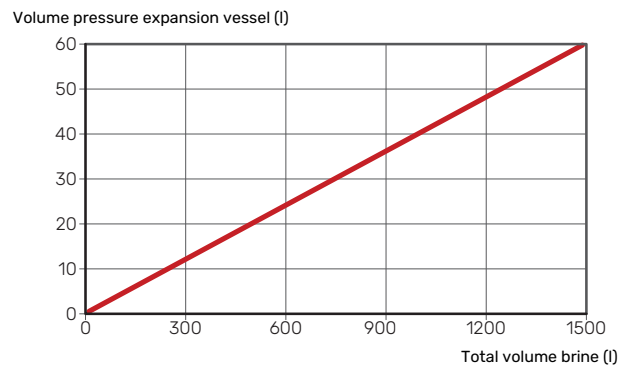

## Ethylene glycol 40% (volume percent)

In installations with ethylene glycol (40% volume percent) as the brine the pressure expansion vessel must be dimensioned according to the following diagram.

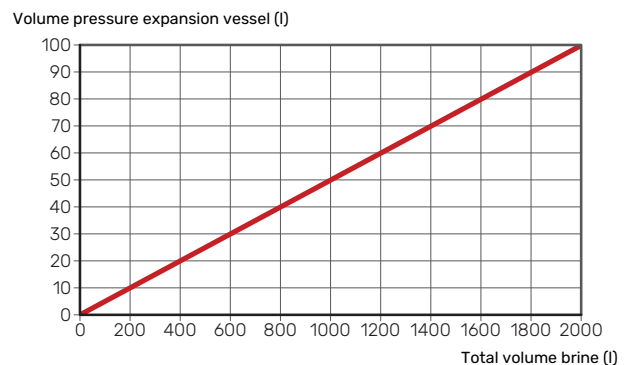

## CLIMATE SYSTEM



A climate system is a system that regulates the indoor temperature with the help of the control system in F1355 and, for example, radiators, underfloor heating/cooling, fan coils, etc.

- Install the necessary safety equipment and shut-off valves (installed as close to F1355 as possible so that the flow to individual cooling modules can be shut off).
- Fit the enclosed filterballs on the incoming pipe.

- The safety valve must have a maximum 0.6 MPa (6.0 bar) opening pressure and be installed on the heating medium return. The entire length of the overflow water pipe from the safety valve must be inclined, to prevent water pockets and must also be frost-free.
- When connecting to a system with thermostats on all radiators, a relief valve must be fitted, or some of the thermostats must be removed to ensure sufficient flow.
- Fit the supplied non-return valves on the outgoing pipe.

When necessary you should install vent valves in the climate system.

F1355 is designed so that heating production can be performed using one or two cooling modules. However, this entails different pipe or electrical installations.

### COLD AND HOT WATER



Any docked hot water heater must be fitted with necessary set of valves.

- 
- A mixer valve must also be installed, if the factory setting for hot water is changed. National regulations must be observed.
- The safety valve must have max. 1.0 MPa (10.0 bar) opening pressure, and be installed on the incoming domestic water line.

The heat pump/system is designed so that hot water production can be carried out with one or several cooling modules. However, this entails different pipe or electrical installations. Hot water production takes place via cooling module as standard.

Ensure that incoming water is clean. When using a private well, it may be necessary to supplement with an extra water filter.

For more information see [nibe.eu](http://nibe.eu).

## Guideline values for collectors

The length of the collector hose varies depending on the rock/soil conditions, climate zone and on the climate system (radiators or underfloor heating) and the heating requirement of the building. Each installation must be sized individually.

Max. length per coil for the collector should not exceed 500 m.

The collectors must always be connected in parallel with the possibility of adjusting the flow for the relevant coil.

For surface soil heat, the hose should be buried at a depth determined by local conditions and the distance between the hoses should be at least 1 metre.

For several bore holes, the distance between the holes must be determined according to local conditions.

Ensure the collector hose rises constantly towards the heat pump to avoid air pockets. If this is not possible, airvents should be used.


Because the temperature of the brine system may fall below 0 °C, it must be protected against freezing down to -15 °C. When making the volume calculation, 1 litres of ready mixed brine per metre of collector hose (applies when using PEM-hose 40x2.4 PN 6.3) is used as a guide value.

# Installation alternative



F1355 is a flexible product with advanced control equipment and can be adapted to several different system solutions. It is possible to combine F1355 with hot water heating, extra additional heating, ventilation recovery, cooling, etc.

The example below shows F1355 together with hot water heating and step controlled additional heat. Contact your NIBE dealer for more information about how to construct your installation.

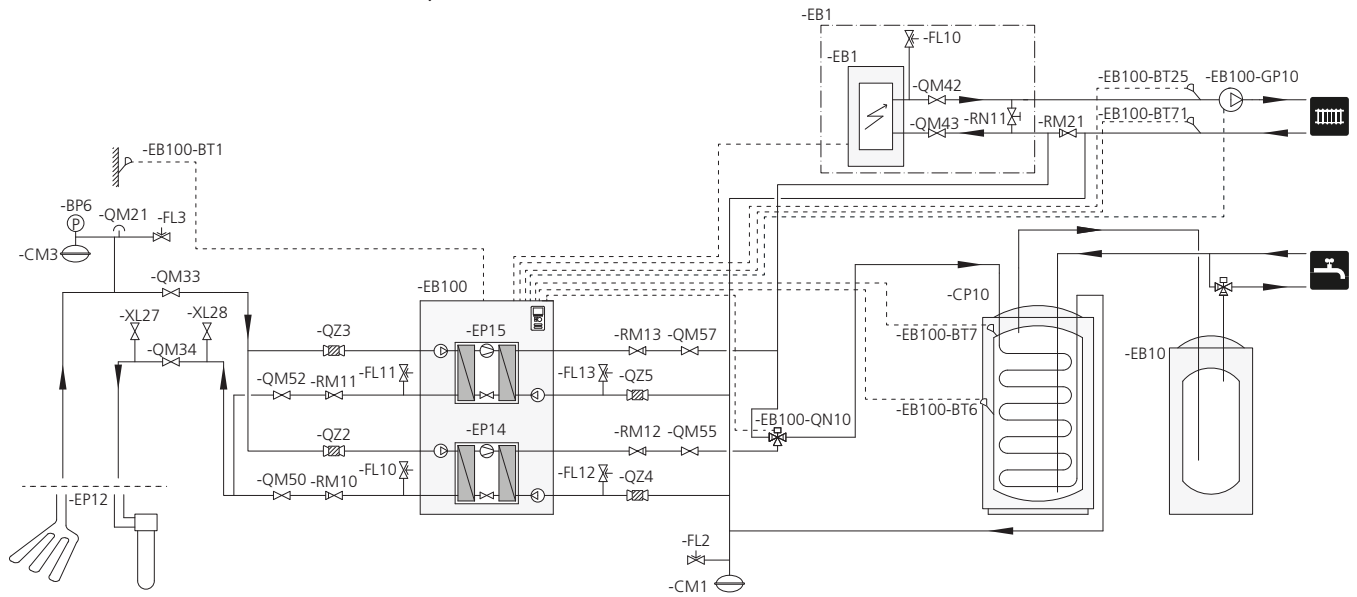



# Functions

## Control, general

The indoor temperature depends on several different factors. Sunlight and heat emissions from people and household machines are normally sufficient to keep the house warm during the warm seasons. When it gets colder outside, the climate system needs to help heat the house. The colder it is outside, the warmer radiators and underfloor heating systems have to be.

The heat pump is controlled by built-in supply and return brine temperature sensors (collector). Brine return temperatures can, if necessary, be limited to a minimum e.g. for ground water systems.

Control of the heat production is performed based on the "floating condensing" principle, which means that the temperature level needed for heating at a specific outdoor temperature is produced based on collected values from the outdoor and supply temperature sensors. The room sensor can also be used to compensate the deviation in room temperature.

## Heat production



The supply of heat to the house is regulated in accordance with the heating curve selected setting. After adjustment, the correct amount of heat for the current outdoor temperature is supplied. The supply temperature will oscillate around the theoretically desired value.

Heat production can take place using one or several compressors.

### OWN CURVE

F1355 has pre-programmed non-linear heating curves. It is also possible to create your own defined curve. This is an individual linear curve with a number of break points. You select break points and the associated temperatures.

## Hot water production



This function requires the accessories VST 11 or VST 20.

If the water heater is docked to F1355 and there is a hot water demand, the heat pump's software control prioritizes the hot water charging mode with optimal heat pump power. Heating is produced by the second compressor in this mode.

Hot water charging starts when the temperature has fallen to the set start temperature. Hot water charging stops when the hot water temperature at the hot water sensor has been reached.

For temporary higher hot water demand, there is a function that allows the temperature to be raised temporarily for up to 12 hours or by a one time increase (can be selected in the menu system).

With the Smart Control function activated, F1355 learns how much hot water is used and when. The Smart Control function memorises the previous week's hot water consumption and adapts the hot water temperature for the coming week to ensure minimal energy consumption.

It is also possible to set F1355 in holiday mode, which means that the lowest possible temperature is achieved without the risk of freezing.

## Master/slave



Several heat pumps can be interconnected by selecting one heat pump as master and the others as slaves. Ground source heat pump models with master/slave functionality from NIBE can be connected to F1355.

For optimum operation: select a heat pump with an inverter-controlled compressor as master.

The heat pump is always delivered as master and up to till 8 slaves can be connected to it. In systems with several heat pumps, each pump must have a unique name, i.e. only one heat pump can be "Master" and only one can be e.g. "Slave 5".

External temperature sensors and control signals must be connected solely to the master, except for external control of the compressor module and reversing valve(s) that can be connected one to each heat pump.

## Additional heat only



If F1355 is docked to external additional heat, the installation can be used exclusively with additional heat to produce heating and hot water, for example, before the collector installation is complete.

## Alarm indications



The status lamp lights red in the event of an alarm and the display shows detailed information depending on the fault. An alarm log is created with each alarm containing a number of temperatures, times and operating status.

## Floor drying



F1355 has an integrated underfloor drying function. This allows for controlled drying of concrete slabs. It is possible to create your own program or to follow a pre-programmed time and temperature schedule. External additional heat is required to activate the function.

## NIBE Uplink



Using the Internet and NIBE Uplink, you can obtain a quick overview and the present status of the installation and the heating in your home. You can obtain a good overall view, allowing you to monitor and control the heating and hot water comfort effectively. If the system is affected by a malfunction, you receive an alert via e-mail that allows you to react quickly.

NIBE Uplink also gives you the opportunity to control the comfort in your home easily, no matter where you are.

### RANGE OF SERVICES

You have access to different levels of service via NIBE Uplink. A basic level that is free and a premium level where you can select different extended service functions for a fixed annual subscription fee (the subscription fee varies depending on the selected functions).

NIBE Uplink also available as an app from App Store and Google Play.

### INSTALLATION AND ASSOCIATED EQUIPMENT REQUIREMENTS

NIBE Uplink needs the following in order to communicate with your F1355:

- network cable
- Internet connection to which F1355 can be connected
- web browser with JavaScript activated
- account on nibeuplink.com

We recommend our mobile app for NIBE Uplink.

For more information, visit [nibeuplink.com](http://nibeuplink.com).

### NIBE SMART PRICE ADAPTION™



Smart Price Adaption is not available in all countries. Contact your NIBE dealer for more information.

Smart Price Adaption adjusts the system's consumption according to the time of day when electricity prices are lowest. This allows for savings, provided that an hourly rate subscription has been signed with the electricity supplier.

The function is based on hourly rates for the coming day being downloaded via NIBE Uplink. To use the function, an Internet connection and account on NIBE Uplink are necessary.

## The display



F1355 is controlled using a clear and easy to use display.

Instructions, settings and operational information are shown on the display. You can easily navigate between the different menus and options to set the comfort or obtain the information you require.

The display unit is equipped with a USB socket that can be used to update the software and save logged information in F1355.

Visit [nibeuplink.com](http://nibeuplink.com) and click the "Software" tab to download the latest software for your installation.

## Extended functions

Visit [nibe.eu](http://nibe.eu) for further information about which functions are possible with F1355.

### POOL



Up to two different pool systems can be connected to F1355 and controlled individually; however, this requires two POOL 40- or AXC accessories.

During pool heating, the heating medium is circulated between the heat pump and the pool exchanger using the heat pump's internal circulation pumps.

### EXTRA CLIMATE SYSTEM



Up to seven extra climate systems can be connected to F1355. These can be configured for either heating or cooling. This function requires the accessory ECS 40/ECS 41 or AXC 50 if larger separate shunt valves are needed.

### COOLING



The F1355, along with accessories, can distribute cooling to the climate system. The following cooling functions require the accessory AXC 50:


- Passive cooling in 4 pipe system
- Passive cooling in 2 pipe system
- Passive/active cooling in 2 pipe system

The following function requires the accessory ACS 45:


- Passive/active cooling in 4 pipe system

# Technical data

## Dimensions

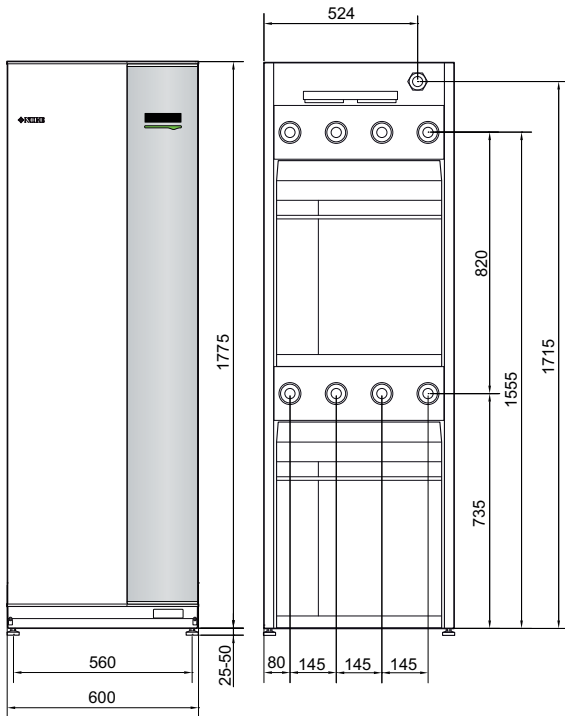

## Pipe connections

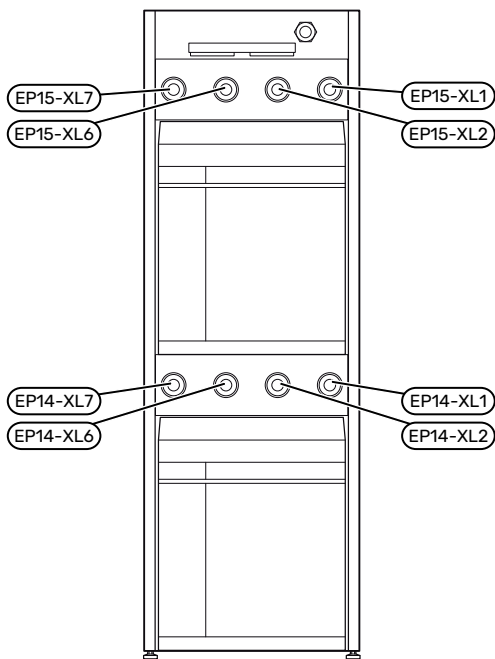

| Connection                  |  |
|-----------------------------|--|
| (XL1) Heating medium supply | internal thread G 1½<br>external thread G2 |
| (XL2) Heating medium return | internal thread G 1½<br>external thread G2 |
| (XL6) Brine in              | internal thread G 1½<br>external thread G2 |
| (XL7) Brine out             | internal thread G 1½<br>external thread G2 |

# Technical specifications

| Model   |           | F1355-28                                  | F1355-43      |
|---|-----------|---|---------------|
| <b>Output data according to EN 14511</b>  |           |   |               |
| Heating capacity ( $P_H$ )  | kW        | 4 - 28                                    | 6 - 43        |
| <b>0/35</b>   |           |   |               |
| Heating capacity ( $P_H$ )  | kW        | 20.77                                     | 31.10         |
| Supplied power ( $P_E$ )  | kW        | 4.56                                      | 7.1           |
| COP   | -         | 4.55                                      | 4.38          |
| <b>0/45</b>   |           |   |               |
| Heating capacity ( $P_H$ )  | kW        | 19.87                                     | 29.03         |
| Supplied power ( $P_E$ )  | kW        | 5.54                                      | 8.4           |
| COP   | -         | 3.59                                      | 3.46          |
| <b>10/35</b>  |           |   |               |
| Heating capacity ( $P_H$ )  | kW        | 26.68                                     | 40.42         |
| Supplied power ( $P_E$ )  | kW        | 4.76                                      | 7.33          |
| COP   | -         | 5.60                                      | 5.52          |
| <b>10/45</b>  |           |   |               |
| Heating capacity ( $P_H$ )  | kW        | 25.71                                     | 38.5          |
| Supplied power ( $P_E$ )  | kW        | 5.84                                      | 8.92          |
| COP   | -         | 4.40                                      | 4.31          |
| <b>Output data according to EN 14825</b>  |           |   |               |
| $P_{designhr}$ 35 °C / 55 °C  | kW        | 28  | 45 / 42       |
| SCOP cold climate, 35 °C / 55 °C  | -         | 5.4 / 4.2                                 | 5.3 / 4.1     |
| SCOP average climate, 35 °C / 55 °C   | -         | 5.0 / 4.0                                 | 5.0 / 4.0     |
| <b>Energy rating, average climate</b>   |           |   |               |
| The product's room heating efficiency class 35 °C / 55 °C <sup>1</sup>                              | -         | A+++ / A+++                               | A+++ / A+++   |
| The system's room heating efficiency class 35 °C / 55 °C <sup>2</sup>                               | -         | A+++ / A+++                               | A+++ / A+++   |
| <b>Electrical data</b>  |           |   |               |
| Rated voltage   | -         | 400V 3N - 50Hz                            |               |
| Max operating current, heat pump  | $A_{rms}$ | 22.1                                      | 25.6          |
| Max. operating current, compressor EP14 / EP15  | $A_{rms}$ | 9.5 / 8.5                                 | 13.1 / 11.9   |
| Recommended fuse rating   | A         | 25  | 30            |
| Starting current  | $A_{rms}$ | 27.7                                      | 33.6          |
| Max permitted impedance at connection point <sup>3</sup>  | ohm       | -   | -             |
| Total output, Brine pumps   | W         | 6 - 360                                   | 16 - 620      |
| Total output, HM pumps  | W         | 5 - 174                                   | 3 - 227       |
| Enclosure class   | -         | IP 21                                     |               |
| <b>Refrigerant circuit</b>  |           |   |               |
| Type of refrigerant EP14 / EP15   | -         | R407C / R407C                             | R410A / R407C |
| Fill amount EP14 / EP15   | kg        | 2.2 / 2.0                                 | 2.1 / 1.7     |
| GWP refrigerant EP14 / EP15   | -         | 1,774 / 1,774                             | 2,088 / 1,774 |
| CO <sub>2</sub> equivalent EP14 / EP15  | ton       | 3.90 / 3.55                               | 4.39 / 3.02   |
| <b>Brine circuit</b>  |           |   |               |
| Max system pressure brine   | MPa       | 0.6 (6 bar)                               | 0.6 (6 bar)   |
| Flow at $P_{designhr}$  | l/s       | 1.55                                      | 2.44          |
| External available pressure at $P_{designhr}$   | kPa       | 80  | 70            |
| Min/Max incoming Brine temp   | °C        | see diagram                               |               |
| Min. outgoing brine temp.   | °C        | -12                                       | -12           |
| <b>Heating medium circuit</b>   |           |   |               |
| Max system pressure heating medium  | MPa       | 0.6 (6 bar)                               | 0.6 (6 bar)   |
| Flow at $P_{designhr}$  | l/s       | 0.65                                      | 1.0           |
| External available pressure at $P_{designhr}$   | kPa       | 70  | 80            |
| Min/max HM-temp   | °C        | see diagram                               |               |
| <b>Noise</b>  |           |   |               |
| Sound power level ( $L_{WA}$ ) according to EN 12102 at 0/35  | dB(A)     | 47  | 47            |
| Sound pressure level ( $L_{PA}$ ) calculated values according to EN ISO 11203 at 0/35 and 1 m range | dB(A)     | 32  | 32            |
| <b>Pipe connections</b>   |           |   |               |
| Brine diam. CU pipe   | -         | G50 (2" external) / G40 (1 1/2" internal) |               |

| Model                                  |    | F1355-28                                  | F1355-43   |
|--|----|---|------------|
| Heating medium diam. CU pipes          | -  | G50 (2" external) / G40 (1 1/2" internal) |            |
| <b>Compressor oil</b>                  |    |   |            |
| Oil type                               | -  | POE                                       |            |
| Volume EP14 / EP15                     | l  | 1.45 / 1.9                                | 1.45 / 1.9 |
| <b>Dimensions and weight</b>           |    |   |            |
| Width                                  | mm | 600                                       |            |
| Depth                                  | mm | 620                                       |            |
| Height                                 | mm | 1,800                                     |            |
| Required ceiling height <sup>4</sup>   | mm | 1,950                                     |            |
| Weight complete heat pump              | kg | 335                                       | 362        |
| Weight only cooling module EP14 / EP15 | kg | 125 / 130                                 | 126 / 144  |
| Part no., 3x400V                       |    | 065 436                                   | 065 496    |

<sup>1</sup> Scale for the product's efficiency class room heating: A+++ to D.

<sup>2</sup> Scale for the system's efficiency class room heating: A+++ to G. Reported efficiency for the system takes the product's temperature regulator into account.


<sup>3</sup> Max permitted impedance in the mains connection point in accordance with EN 61000-3-11. Start currents can cause short voltage dips that may affect other equipment in unfavourable conditions. If the impedance in the mains connection point is higher than that stated, it is probable that interference will occur. If the impedance in the mains connection point is higher than that stated, check with the power supplier before purchasing the equipment.

<sup>4</sup> With feet removed, the height is approx. 1930 mm.


**WORKING RANGE HEAT PUMP, COMPRESSOR OPERATION**  
**28 kW**

The compressor provides a supply temperature up to 65 °C.

**Cooling module EP14**

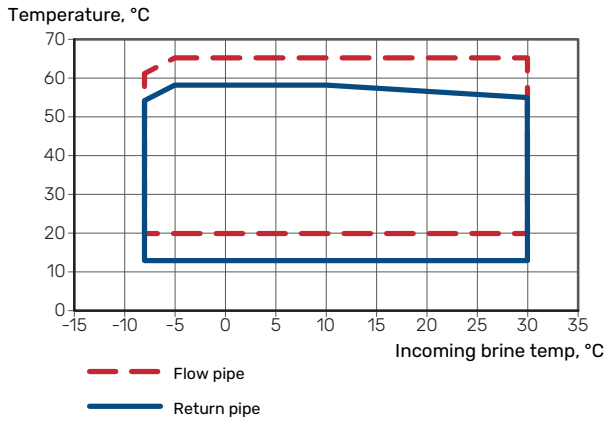


**Cooling module EP15**

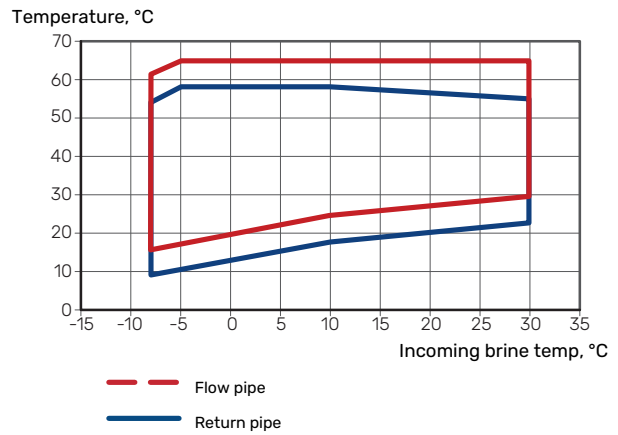


**43 kW**

**Cooling module EP14**

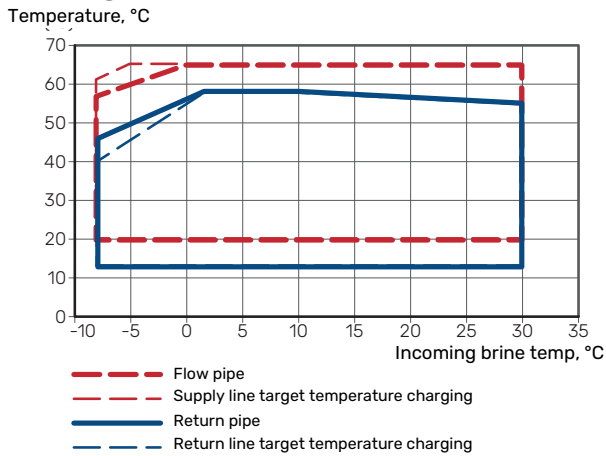

**Cooling module EP15**

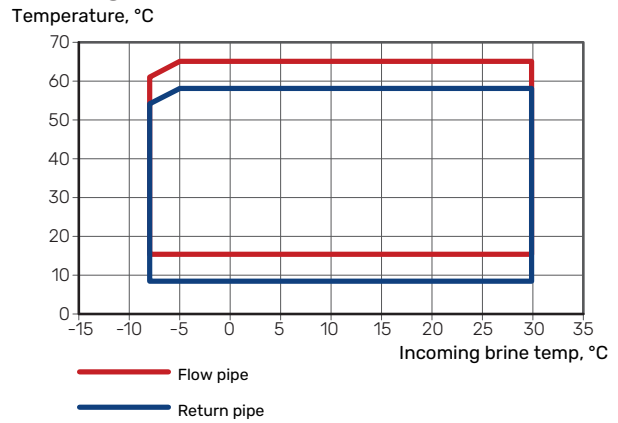

## PUMP CAPACITY DIAGRAM

### Brine side


To set the correct flow in the brine system, the brine pump must run at the correct speed. F1355 has a brine pump that is controlled automatically in standard mode.

For optimum operation when several heat pumps are installed in a multi-installation, all heat pumps should have the same compressor size.


- 1 circulation pump
- - - 2 circulation pumps

### F1355 28 kW

External available pressure  
(kPa)

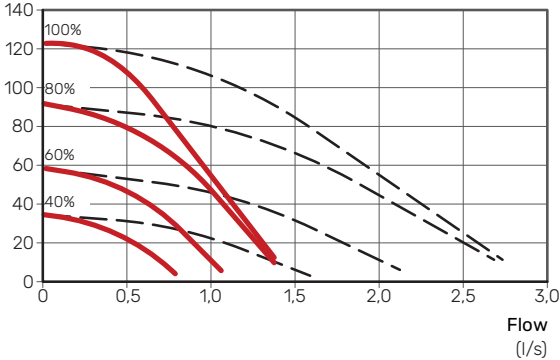


Electrical power circulation pump  
(w)

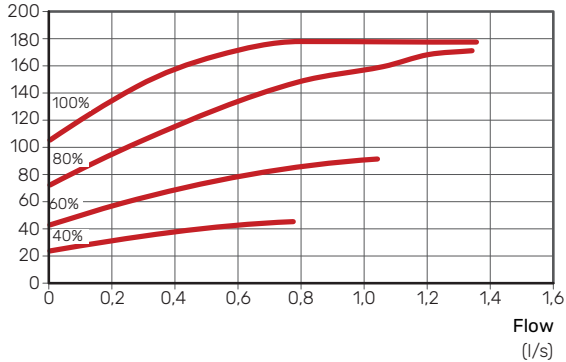


### F1355 43 kW

External available pressure  
(kPa)

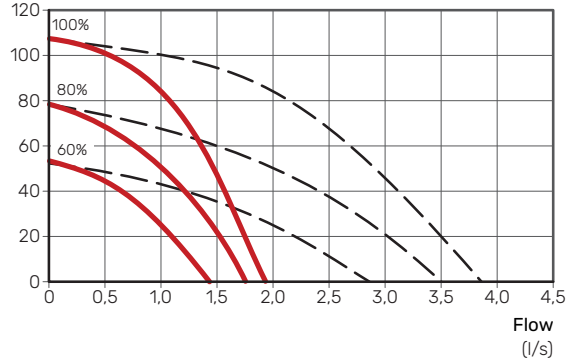

Electrical power circulation pump  
(w)

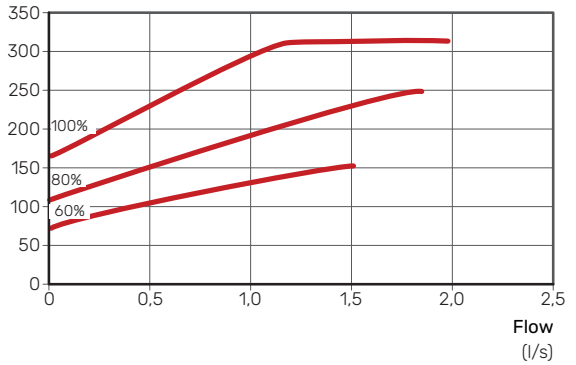


## Climate system

To set the correct flow in the climate system, the heating medium pump must run at the correct speed. F1355 has a heating medium pump that can be automatically controlled in standard mode.


- 1 circulation pump
- 2 circulation pumps

### F1355 28 kW

External available pressure (kPa)

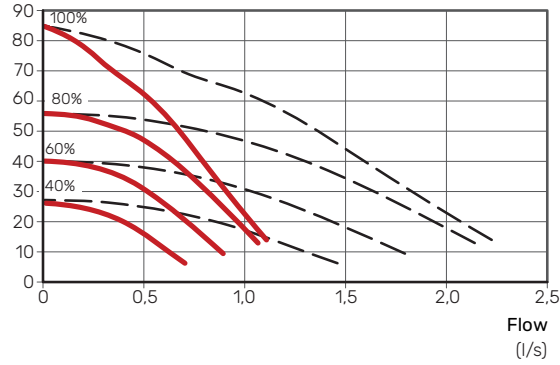


Electrical power circulation pump (W)

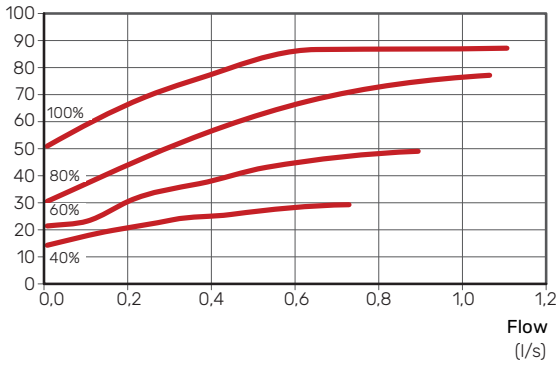


### F1355 43 kW

- EP14
- EP15
- - - EP14 and EP15

External available pressure (kPa)

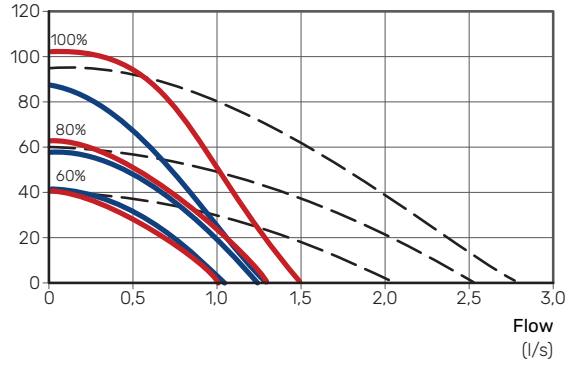

Electrical power circulation pump (W)

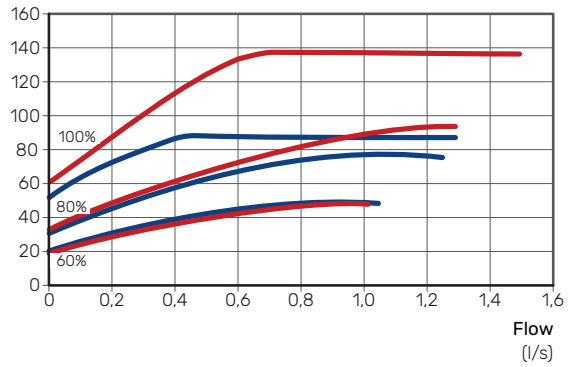




## Accessories

Not all accessories are available on all markets.

Detailed information about the accessories and complete accessories list available at [nibe.eu](http://nibe.eu).

### ACTIVE/PASSIVE COOLING IN 4-PIPE SYSTEM ACS 45

ACS 45 is an accessory that makes it possible for your heat pump to control the production of heating and cooling independently of each other.



### ACTIVE/PASSIVE COOLING IN 2-PIPE SYSTEM HPAC 45

Combine F1355 with HPAC 45 for passive or active cooling.

Intended for heat pumps with outputs 24 – 60 kW.



### EXTERNAL ELECTRIC ADDITIONAL HEAT ELK


These accessories may need an accessory board AXC 50 (step controlled additional heat).

**ELK 15**  
15 kW, 3 x 400 V

**ELK 26**  
26 kW, 3 x 400 V


**ELK 42**  
42 kW, 3 x 400 V

**ELK 213**  
7–13 kW, 3 x 400 V




### EXTRA SHUNT GROUP ECS 40/ECS 41

This accessory is used when F1355 is installed in houses with two or more different heating systems that require different supply temperatures.



### HUMIDITY SENSOR HTS 40

This accessory is used to show and regulate humidity and temperatures during both heating and cooling operation.



### AUXILIARY RELAY HR 10

Auxiliary relay HR 10 is used to control external 1 to 3 phase loads such as oil burners, immersion heaters and pumps.



### COMMUNICATIONS MODULE MODBUS 40


MODBUS 40 enables F1355 to be controlled and monitored using a DUC (computer sub-centre) in the building.



### ASSEMBLY SYSTEM FMS 40/42


In systems where both the compressors are working to the same demand, 2 x packs of FMS 40 are required.

In systems where the lower compressor is used for hot water production or pool, 1 x pack of FMS 40 and 1 x pack of FMS 42 are required.



### FILLING VALVE KIT, BRINE 32

Valve kit for filling brine in the collector hose. Includes particle filter and insulation.




### CURRENT SENSOR CMS 10-200

Current sensor with working area 0-200 A.



### ACCESSORY BOARD AXC 50

An accessory board is required if, for example, a ground water pump or external circulation pump is to be connected to F1355 at the same time as the indication of common alarm is activated.




### BUFFER VESSEL UKV

A buffer vessel is an accumulator tank that is suitable for connection to a heat pump or another external heat source, and can have several different applications.



### WATER HEATER/ACCUMULATOR TANK


For information regarding suitable water heaters, see [nibe.eu](http://nibe.eu).



### HOT WATER CONTROL

#### VST 20

Reversing valve, copper pipe Ø35  
(Max recommended power, 40 kW)







# Sustainable energy solutions since 1952

---

NIBE has been manufacturing energy-efficient and sustainable climate solutions for your home for 70 years. It all began in Markaryd, in the southern Swedish province of Småland, and we recognise our Nordic heritage by utilising the power of nature. We combine renewable energy with smart technology to offer efficient solutions, allowing us to work together to create a more sustainable future.

Regardless of whether it is a chilly winter's day or a warm afternoon in the summer sun, we need a balanced indoor climate that allows us to enjoy a comfortable life, whatever the weather. Our extensive range of products supply your home with cooling, heating, ventilation and hot water, making it possible for you to create a pleasant indoor climate with little impact on the environment.

NIBE Energy Systems  
Box 14, SE-285 21 Markaryd  
nibe.eu



---

This product sheet is a publication from NIBE Energy Systems. All product illustrations, facts and data are based on current information at the time of the publication's approval. NIBE Energy Systems makes reservations for any factual or printing errors in this product sheet.