

UHB EN 1951-5
331398

USER MANUAL

Air/water heat pump

NIBE F2120 *8, 12, 16, 20*



 **NIBE**

Table of Contents

<i>1 Important information</i>	<i>4</i>
Installation data	4
Safety information	5
Symbols	6
Marking	6
Serial number	7
F2120 – An excellent choice	7
<i>2 The heat pump – the heart of the house</i>	<i>9</i>
Heat pump function	9
Control of F2120	11
Maintenance of F2120	12
<i>3 Disturbances in comfort</i>	<i>19</i>
Troubleshooting	19
<i>4 Technical data</i>	<i>20</i>
<i>5 Glossary</i>	<i>21</i>
<i>Item register</i>	<i>26</i>
<i>Contact information</i>	<i>27</i>

1 Important information

Installation data

<i>Product</i>	<i>F2120</i>
Serial number	
Installation date	
Installer	

Serial number must always be given.

Certification that the installation is carried out according to instructions in NIBE's installer manual and applicable regulations.

Date _____ Signed _____

Safety information

This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved. The product is intended for use by experts or trained users in shops, hotels, light industry, farming and similar environments. Children must be instructed/supervised to ensure that they do not play with the appliance.

Do not allow children to clean or maintain the appliance unsupervised.

This is an original manual. It may not be translated without the approval of NIBE.

Rights to make any design or technical modifications are reserved.

©NIBE 2020.

F2120 must be installed via an isolator switch. The cable area has to be dimensioned based on the fuse rating used. If the supply cable is damaged, only NIBE, its service representative or similar authorised person may replace it to prevent any danger and damage.

Symbols



NOTE

This symbol indicates danger to person or machine .



Caution

This symbol indicates important information about what you should observe when maintaining your installation.



TIP

This symbol indicates tips on how to facilitate using the product.

Marking

CE

The CE mark is obligatory for most products sold in the EU, regardless of where they are made.

IP24

Classification of enclosure of electro-technical equipment.



Danger to person or machine.




Read the User Manual.



Read the Installer Manual.

Serial number

The serial number can be found at the top left on the rear cover and at the bottom on the side.

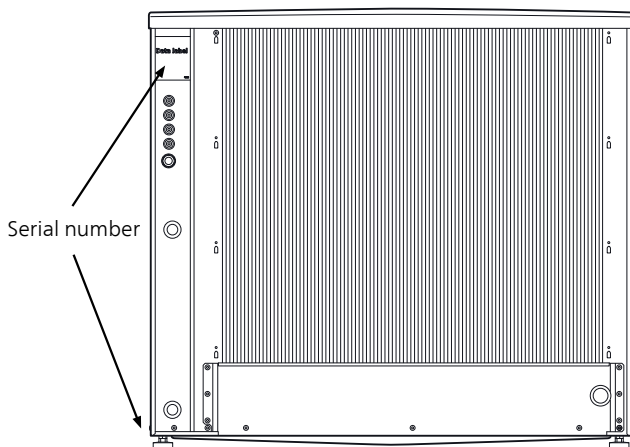

Caution

You need the product's (14 digit) serial number for servicing and support.

F2120 – An excellent choice

F2120 is an air/water heat pump, specially designed for the Nordic climate, which uses the outdoor air as its energy source.

The heat pump is intended for connection to water borne heating systems and can both heat hot water effectively at high outdoor temperatures and give a high output to the heating system at low outdoor temperatures.

If the outdoor temperature drops to a level below the stop temperature all heating must then occur with external additional heat.

EXCELLENT PROPERTIES FOR F2120:

- *Efficient speed-controlled scroll compressor*

Efficient speed-controlled scroll compressor that operates at temperatures down to -25 °C.

- *Intelligent control*

F2120 connected to intelligent control for optimum control of the heat pump.

- *Fan*

F2120 has automatic capacity regulation of the fan.

- *Long service life*

The material has been chosen for a long service life and is designed to withstand the Nordic outdoor conditions.

- *Many possibilities*


F2120 is intended for combination with NIBE indoor module VVM / NIBE control module SMO. There is a wide range of system solutions and accessories for NIBE's indoor modules and control modules.

- *Silent operation*

F2120 has a silent operation function that allows scheduling when F2120 must operate at an even quieter noise level.

2 The heat pump – the heart of the house

Heat pump function

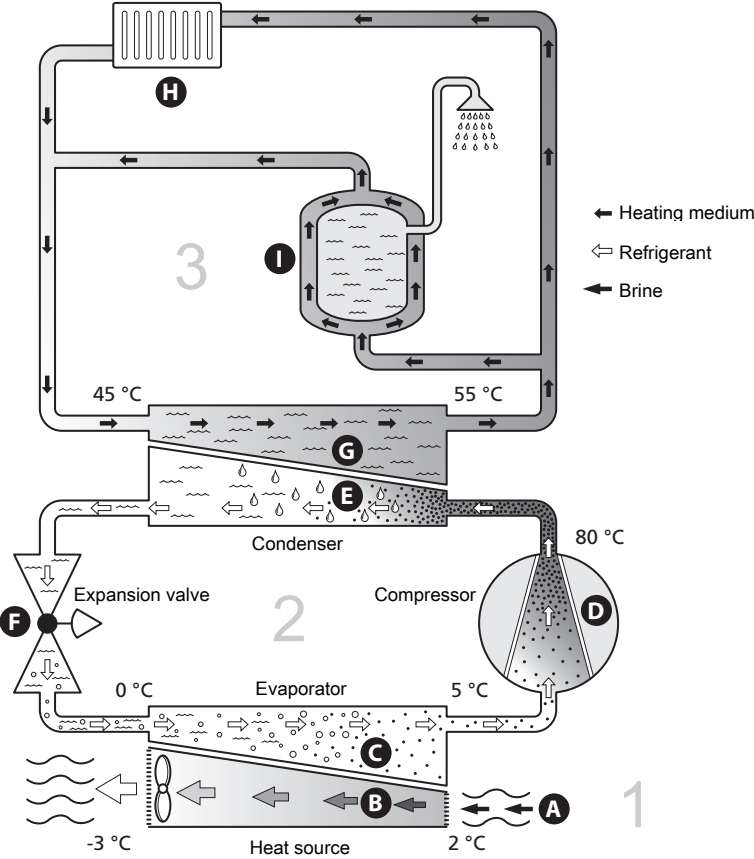

The temperatures are only examples and may vary between different installations and time of year.

An air/water heat pump can use the outdoor air to heat up a home. The conversion of the outdoor air's energy to residential heating occurs in three different circuits. In the brine circuit (1), free heat energy is retrieved from the surroundings and transported to the heat pump. The heat pump increases the retrieved heat's low temperature to a high temperature in the refrigerant circuit, (2). The heat is distributed around the building by the heating medium circuit (3).

Outdoor air

- A** The outdoor air is sucked into the heat pump.
- B** The fan then routes the air to the heat pump's evaporator. Here, the air releases the heating energy to the refrigerant and the air's temperature drops. The cold air is then blown out of the heat pump.

Refrigerant circuit

- C** A gas circulates in a closed system in the heat pump, a refrigerant, which also passes the evaporator. The refrigerant has a very low boiling point. In the evaporator the refrigerant receives the heat energy from the outdoor air and starts to boil.
- D** The gas that is produced during boiling is routed into an electrically powered compressor. When the gas is compressed, the pressure increases and the gas's temperature increases considerably, from 5 °C to approx. 80 °C.
- E** From the compressor, gas is forced into a heat exchanger, condenser, where it releases heat energy to the heating system in the house, whereupon the gas is cooled and condenses to a liquid form again.
- F** As the pressure is still high, the refrigerant can pass an expansion valve, where the pressure drops so that the refrigerant returns to its original temperature. The refrigerant has now completed a full cycle. It is routed to the evaporator again and the process is repeated.

Heat medium circuit


- G** The heat energy that the refrigerant produces in the condenser is retrieved by the climate system's water, heating medium, which is heated to 55 °C (supply temperature).
- H** The heating medium circulates in a closed system and transports the heated water's heating energy to the house water heater and radiators/heating coils.

The temperatures are only examples and may vary between different installations and time of year.

Control of F2120

F2120 is controlled in various ways depending on your system. You control the heat pump via your indoor module (VVM) or control module (SMO) See the relevant manual for more information.

During installation, the installation engineer adjusts the necessary settings for the heat pump in the indoor module or control module, so that the heat pump works optimally in your system.

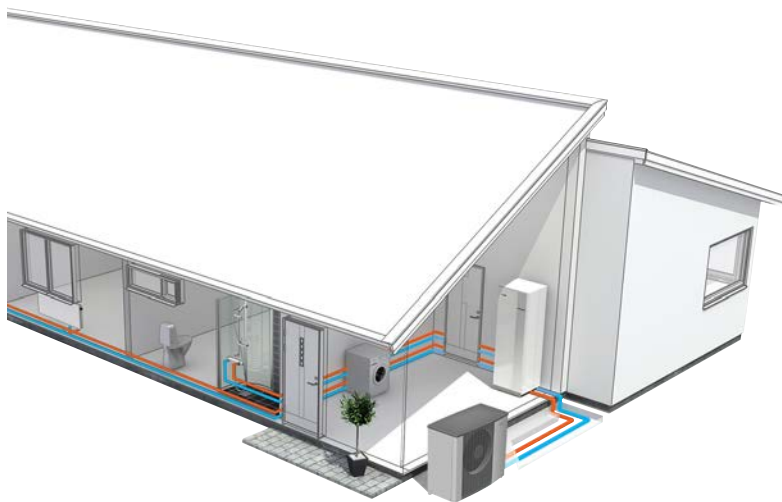

Maintenance of F2120

REGULAR CHECKS

When your heat pump is located outdoors some external maintenance is required.



NOTE

Insufficient maintenance can cause serious damage to F2120, which is not covered by the guarantee.


Checking grilles and bottom panel on F2120

Regularly check throughout the year that the grille is not clogged by leaves, snow or anything else.


You should be vigilant during windy conditions and/or in the event of snow as the grille can become blocked.

Regularly check that condensation is routed away correctly through the condensation pipe. Ask your installer for assistance if required.

Keep free of snow and ice

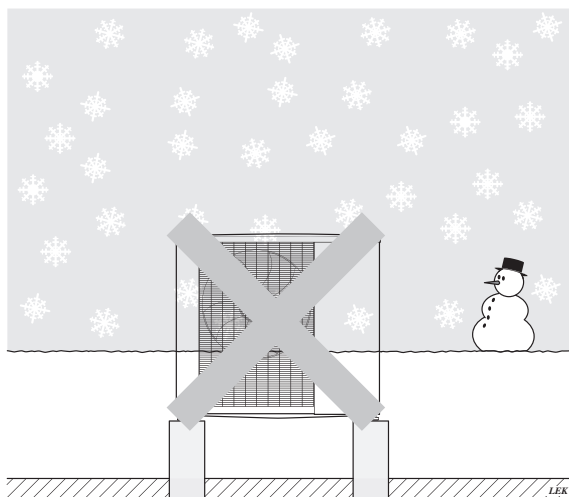

Prevent snow from building up and covering the grilles and drain holes on F2120.

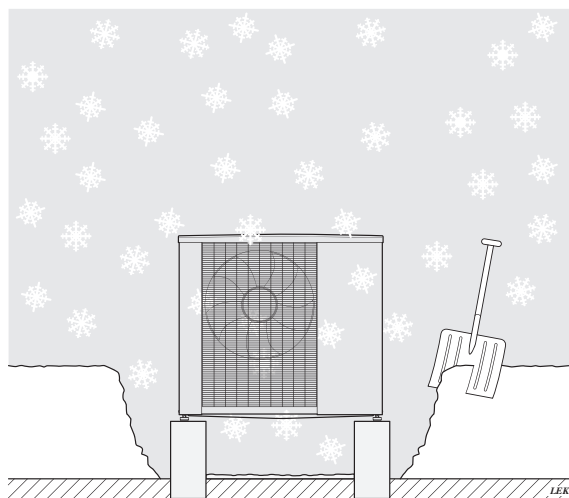

Keep free of snow and/or ice.

Cleaning the outer casing

If necessary the outer casing can be cleaned using a damp cloth.

Care must be exercised so that the heat pump is not scratched when cleaning. Avoid spraying water into the grilles or the sides so that water penetrates into F2120. Prevent F2120 coming into contact with alkaline cleaning agents.

IN EVENT OF LONG POWER CUTS

In the event of prolonged power failures it is recommended that the part of the heating system located outdoors is drained. Your installer has installed a shut off and drain valve to facilitate this. Call and ask your installer if you are unsure.

SILENT MODE



The heat pump can be set to "silent mode", which reduces the heat pump's noise level. The function is useful when F2120 must be placed in noise sensitive areas. The function should only be used for limited periods as F2120 may not reach its dimensioned output.

UPDATING THE SOFTWARE IN F2120 VIA THE CONTROL MODULE OR INDOOR MODULE

The latest software for both F2120 and the indoor module/control module can be found at nibeuplink.com.

Click the "Software" tab to download the latest software for your installation.

Save the files to a USB memory. Update F2120 and the indoor module/control module at the same time.

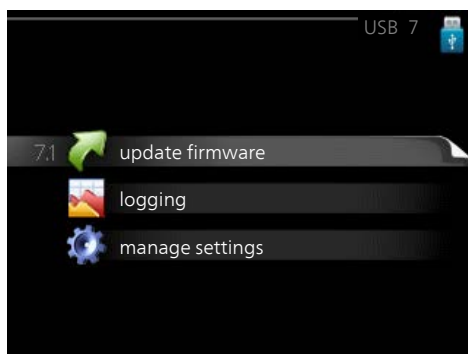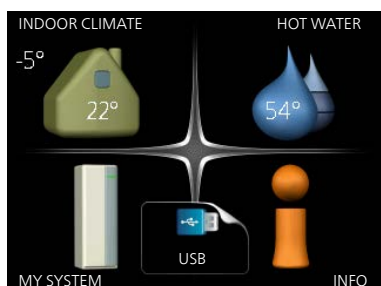

In menu 7.1 on the indoor module/control module, the following software updates can be performed:

- Software for the indoor module (VVM) or control module (SMO)
- Software for outdoor module F2120



Caution

Software for the indoor/control module must be updated when software for outdoor module F2120 is updated.



Caution

It can take up to 30 minutes to update the software for F2120.



Caution

Restart the indoor module/control module to see the correct version number of the software.

For cascade installation, together with SMO 40, all F2120 will be updated in the address order. Deactivate the F2120 that are not to be updated.

More detailed information about updating software via USB can be found in the installer manual for your indoor module or control module.

SAVING TIPS


Your heat pump installation produces heat and cooling and/or hot water. This occurs via the control settings you made.

Factors that affect the energy consumption are, for example, indoor temperature, hot water consumption, the insulation level of the house and whether the house has many large window surfaces. The position of the house, e.g. wind exposure is also an affecting factor.

Also remember:

- Open the thermostat valves completely (except in the rooms that are to be kept cooler for various reasons, e.g. bedrooms). The thermostats slow the flow in the heating system, which the heat pump wants to compensate with increased temperatures. It then works harder and consumes more electrical energy.
- Reduce or adjust the settings for heating in any external control systems.

Power consumption

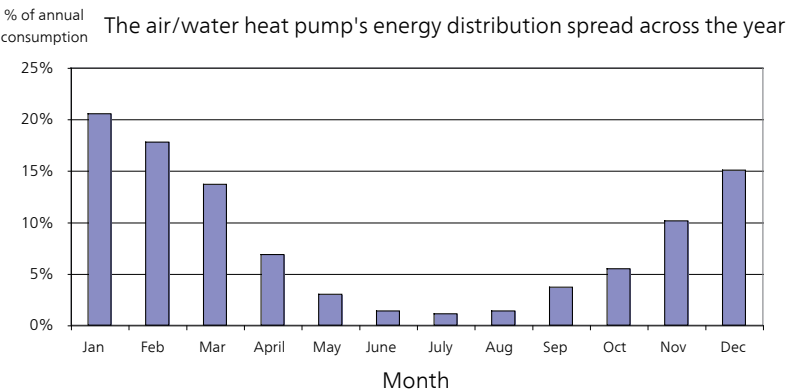

Increasing the indoor temperature one degree increases power consumption by approx. 5%.

Domestic electricity

In the past it has been calculated that an average Swedish household has an approximate annual consumption of 5000 kWh domestic electricity/year. In today's society it is usually between 6000-12000 kWh/year.

Equipment	Normal Output (W)		Appr. ann. consumption (kWh)
	Operation	Standby	
TV (Operation: 5 h/day, Standby: 19 h/day)	200	2	380
Digital box (Operation: 5 h/day, Standby: 19 h/day)	11	10	90
DVD (Operation: 2 h/week)	15	5	45
TV games console (Operation: 6 h/week)	160	2	67
Radio/stereo (Operation: 3 h/day)	40	1	50
Computer incl. screen (Operation: 3 h/day, standby 21 h/day)	100	2	120
Bulb (Operation 8 h/day)	60	-	175
Spot light, Halogen (Operation 8 h/day)	20	-	58
Cooling (Operation: 24 h/day)	100	-	165

<i>Equipment</i>	<i>Normal Output (W)</i>		<i>Appr. ann. consumption (kWh)</i>
Freezer (Operation: 24 h/day)	120	-	380
Stove, hob (Operation: 40 min/day)	1500	-	365
Stove, oven (Operation: 2 h/week)	3000	-	310
Dishwasher, cold water connection (Operation 1 time/day)	2000	-	730
Washing machine (Operation: 1 times/day)	2000	-	730
Tumble drier (Operation: 1 times/day)	2000	-	730
Vacuum cleaner (Operation: 2 h/week)	1000	-	100
Engine block heater (Operation: 1 h/day, 4 months a year)	400	-	50
Passenger compartment heater (Operation: 1 h/day, 4 months a year)	800	-	100

These values are approximate example values.

Example: A family with 2 children live in a house with 1 TVs, 1 digital boxes, 1 DVD players, 1 TV games console, 2 computers, 3 stereos, 2 bulbs in the WC, 2 bulbs in the bathroom, 4 bulbs in the kitchen, 3 bulbs outside, a washing machine, tumble drier, dishwasher, fridge, freezer, oven, vacuum cleaner, engine block heater = 6240 kWh domestic electricity/year

Energy meter

Check the accommodation's energy meter regularly, preferably once a month. This will indicate any changes in power consumption.

Newly built houses usually have twin energy meters, use the difference to calculate your domestic electricity.

New builds

Newly built houses undergo a drying out process for a year. The house can then consume significantly more energy than it would thereafter. After 1-2 years the heating curve should be adjusted again, as well as the offset heating curve and the building's thermostat valves, because the heating system, as a rule, requires a lower temperature once the drying process is complete.

3 Disturbances in comfort

Troubleshooting



NOTE

Work behind covers secured by screws may only be carried out by, or under the supervision of, a qualified installation engineer.



TIP

F2120 communicates all alarms to the indoor module/control module (VVM / SMO).

BASIC ACTIONS

- Make sure that the air flow to F2120 is not blocked by foreign objects.
- Check that F2120 does not have any external damage.

ICE BUILD-UP IN THE FAN, GRILLE AND/OR FAN CONE ON F2120

Contact your installer!

WATER BELOW F2120 (LARGER AMOUNT)

Check that the water drainage via the condensation pipe (KVR 10) is working.

4 Technical data

Detailed technical specifications for this product can be found in the installation manual (nibe.eu).

5 Glossary

ADDITIONAL HEAT

The additional heat is the heat produced in addition to the heat supplied by the compressor in your heat pump. Additional heaters can be for example, immersion heater, electric heater, solar power system, gas/oil/pellet/wood burner or district heating.

AMBIENT TEMPERATURE SENSOR

A sensor that is located outdoors on or close to the heat pump. This sensor tells the heat pump how hot it is where the sensor is located.

BALANCE TEMPERATURE

The balance temperature is the outdoor temperature when the heat pump's stated output is equal to the building's output requirement. This means that the heat pump covers the whole building's output requirement down to this temperature.

CHARGE COIL

A charge coil heats the domestic hot water (tap water) in the water heater with heating water (heating medium) from F2120.

CHARGE PUMP

See "Circulation pump".

CIRCULATION PUMP

Pump that circulates liquid in a pipe system.

CLIMATE SYSTEM

Climate systems can also be called heating systems. The building is heated using radiators, under floor coils or convector fans.

COIL TANK

A heater with a coil in it. The water in the coil heats the water in the heater.

COMPRESSOR

Compresses the gas state refrigerant. When the refrigerant is compressed, the pressure and the temperature increase.

CONDENSER

Heat exchanger where the hot gas state refrigerant condenses (cooled and becomes a liquid) and releases heat energy to the house heating and hot water systems.

COP

If a heat pump has COP of 5, this means that you only pay for a fifth of your heating demand. This is the efficiency of the heat pump. This is measured at different measurement values, e.g.: $7 / 45$ where 7 stands for the outdoor temperature and where 45 stands for how many degrees the supply temperature is maintaining.

DISTURBANCES IN COMFORT

Disturbances in comfort are undesirable changes to the hot water/indoor comfort, for example when the temperature of the hot water is too low or if the indoor temperature is not at the desired level.

A malfunction in the heat pump can sometimes be noticed in the form of a disturbance in comfort.

In most cases, the heat pump notes malfunctions and indicates this with alarms in the display.

DOMESTIC HOT WATER

The water one showers in for example.

DOUBLE-JACKETED TANK

A heater with domestic hot water (tap water) is surrounded by an outer vessel with boiler water (to the house radiators/elements). The heat pump heats the boiler water, which in addition to going out to the all the house radiators/elements, heats the domestic hot water in the inner vessel.

EFFICIENCY

A measurement of how effective the heat pump is. The higher the value is the better it is.

ELECTRICAL ADDITION

This is electricity that, for example, an immersion heater uses as addition during the coldest days of the year to cover the heating demand that the heat pump cannot manage.

EMERGENCY MODE

A mode that can be selected using the switch in the event of a fault, which means that the heat pump does not run. When the heat pump is in emergency mode, the building and/or hot water is heated using an immersion heater.

EVAPORATOR

Heat exchanger where the refrigerant evaporates by retrieving heat energy from the air which then cools.

EXPANSION VALVE

Valve that reduces the pressure of the refrigerant, whereupon the temperature of the refrigerant drops.

EXPANSION VESSEL

Vessel with heating medium fluid with the task of equalising the pressure in the heating medium system.

FAN

During heating operation, the fan transports energy from the ambient air to the heat pump. During cooling, the fan transports energy from the heat pump to the ambient air.

FLOW PIPE

The line in which the heated water is transported from the heat pump out to the house heating system (radiators/heating coils).

HEAT EXCHANGER

Device that transfers heat energy from one medium to another without mixing mediums. Examples of different heat exchangers include evaporators and condensers.

HEAT FACTOR

Measurement of how much heat energy the heat pump gives off in relation to the electric energy it needs to operate. Another term for this is COP.

HEATING MEDIUM

Hot liquid, usually normal water, which is sent from the heat pump to the house climate system and makes the accommodation warm. The heating medium also heats the hot water.

HEATING MEDIUM SIDE

Pipes to the house's climate system make up the heating medium side.

PRESSOSTAT

Pressure switch that triggers an alarm and/or stops the compressor if non-permitted pressures occur in the system. A high pressure pressostat trips if the condensing pressure is too great. A low pressure pressostat trips if the evaporation pressure is too low.

RADIATOR

Another word for heating element. They must be filled with water in order to be used with F2120.

REFRIGERANT

Substance that circulates around a closed circuit in the heat pump and that, through pressure changes, evaporates and condenses. During evaporation, the refrigerant absorbs heating energy and when condensing gives off heating energy.

RETURN PIPE

The line in which the water is transported back to the heat pump from the house heating system (radiators/heating coils).

RETURN TEMP

The temperature of the water that returns to the heat pump after releasing the heat energy to the radiators/heating coils.

SAFETY VALVE

A valve that opens and releases a small amount of liquid if the pressure is too high.

SHUTTLE VALVE

A valve that can send liquid in two directions. A shuttle valve that enables liquid to be sent to the climate system, when the heat pump produces heating for the house, and to the hot water heater, when the heat pump produces hot water.

SILENT MODE

A mode where the maximum level for the output is limited to achieve a noise reduction from the heat pump.

SUPPLY TEMPERATURE

The temperature of the heated water sent by the heat pump to the heating system.

WATER HEATER

Container where domestic water is heated.

Item register

B

Basic actions, 19

C

Control module's function, 9

Control of F2120, 11

D

Disruptions to comfort

Basic actions, 19

Disturbances in comfort, 19

Troubleshooting, 19

F

F2120 – An excellent choice, 7

G

Glossary, 21

H

Heat pump function, 10

I

Ice build-up in the fan, grille and/or fan cone, 19

Important information, 4

F2120 – An excellent choice, 7

Installation data, 4

Safety information, 5

Serial number, 7

Symbols, 6

In event of long power cuts, 14

Installation data, 4

M

Maintenance of F2120, 12

In event of long power cuts, 14

Regular checks, 12

Saving tips, 16

Silent mode, 14

P

Power consumption, 17

R

Regular checks, 12

S

Safety information, 5

Saving tips, 16

Power consumption, 17

Serial number, 7

Silent mode, 14

Symbols, 6

T

Technical data, 20

The heat pump – the heart of the house, 9

Troubleshooting, 19

Ice build-up in the fan, grille and/or fan cone, 19

Water below F2120 (larger amount), 19

W

Water below F2120 (larger amount), 19

Contact information

- AT** *KNV Energietechnik GmbH*, Gahberggasse 11, AT-4861 Schörfling
Tel: +43 (0)7662 8963 E-mail: mail@knv.at www.knv.at
- CH** *NIBE Wärmetechnik c/o ait Schweiz AG*,
Industriepark, CH-6246 Altishofen Tel: +41 58 252 21 00
E-mail: info@nibe.ch www.nibe.ch
- CZ** *Druzstevni zavody Drazice s.r.o.*,
Drazice 69, CZ - 294 71 Benatky nad Jizerou
Tel: +420 326 373 801 E-mail: nibe@nibe.cz www.nibe.cz
- DE** *NIBE Systemtechnik GmbH*, Am Reiherpfahl 3, 29223 Celle
Tel: +49 (0)5141 7546-0 E-mail: info@nibe.de www.nibe.de
- DK** *Vølund Varmeteknik A/S*, Member of the Nibe Group,
Industrivej Nord 7B, 7400 Herning Tel: +45 97 17 20 33
E-mail: info@volundvt.dk www.volundvt.dk
- FI** *NIBE Energy Systems OY*, Juurakkotie 3, 01510 Vantaa
Tel: +358 (0)9-274 6970 E-mail: info@nibe.fi www.nibe.fi
- FR** *NIBE Energy Systems France Sarl*, Zone industrielle RD 28, Rue du Pou du Ciel, 01600 Reyrieux
Tel : 04 74 00 92 92 E-mail: info@nibe.fr www.nibe.fr
- GB** *NIBE Energy Systems Ltd*,
3C Broom Business Park, Bridge Way, S419QG Chesterfield
Tel: +44 (0)845 095 1200 E-mail: info@nibe.co.uk www.nibe.co.uk
- NL** *NIBE Energietechnik B.V.*, Postbus 634, NL 4900 AP Oosterhout
Tel: 0168 477722 E-mail: info@nibenl.nl www.nibenl.nl
- NO** *ABK AS*, Brobekkveien 80, 0582 Oslo
Tel: +47 23 17 05 20 E-mail: post@abkklima.no
www.nibe.no
- PL** *NIBE-BIAWAR Sp. z o. o.* Aleja Jana Pawła II 57, 15-703 BIALYSTOK
Tel: +48 (0)85 662 84 90 E-mail: sekretariat@biawar.com.pl
www.biawar.com.pl
- RU** © "EVAN" 17, per. Boynovskiy, RU-603024 Nizhny Novgorod
Tel: +7 831 419 57 06 E-mail: kuzmin@evan.ru www.nibe-evan.ru
- SE** *NIBE AB Sweden*, Box 14, Hannabadsvägen 5, SE-285 21 Markaryd
Tel: +46 (0)433 27 3000 E-mail: info@nibe.se www.nibe.se

For countries not mention in this list, please contact Nibe Sweden or check www.nibe.eu for more information.

NIBE Energy Systems
Hannabadsvägen 5
Box 14
SE-285 21 Markaryd
info@nibe.se
nibe.eu

UHB EN 1951-5 331398

This manual is a publication from NIBE Energy Systems. All product illustrations, facts and data are based on the available information at the time of the publication's approval. NIBE Energy Systems makes reservations for any factual or printing errors in this manual.



331398