

Air/water heat pump

NIBE F2050



Table of Contents

1	Important information _____	4
	Installation data _____	4
	Symbols _____	4
	Serial number _____	5
2	Installation function _____	6
3	Control of F2050 _____	8
4	Maintenance of F2050 _____	9
	Regular checks _____	9
	In event of long power cuts _____	9
	Silent mode _____	9
	Updating the software _____	9
5	Disturbances in comfort _____	10
	Troubleshooting _____	10
	Contact information _____	11

Important information

For the latest version of the product's documentation, see nibe.eu.

Installation data

Product	F2050
Serial number	
Installation date	
Installer	

Accessories	


Serial number must always be given.


Certification that the installation is carried out according to instructions in the accompanying installer manual and applicable regulations.


Date _____ Signed _____

Symbols

Explanation of symbols that may be present in this manual.


 **CAUTION!**
This symbol indicates danger to person or machine.

 **NOTE!**
This symbol indicates important information about what you should observe when maintaining your installation.


 **TIP!**
This symbol indicates tips on how to facilitate using the product.

Serial number

The serial number for F2050-6 and F2050-10 can be found on the side of the foot.

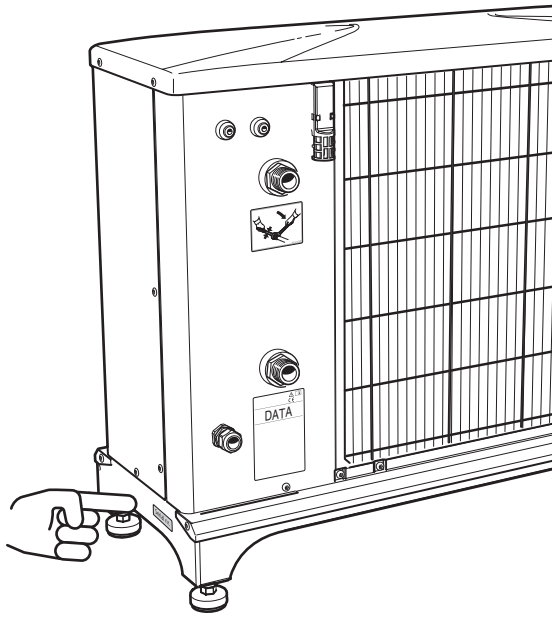

The serial number for F2050-12 and F2050-16 can be found on the right-hand side.

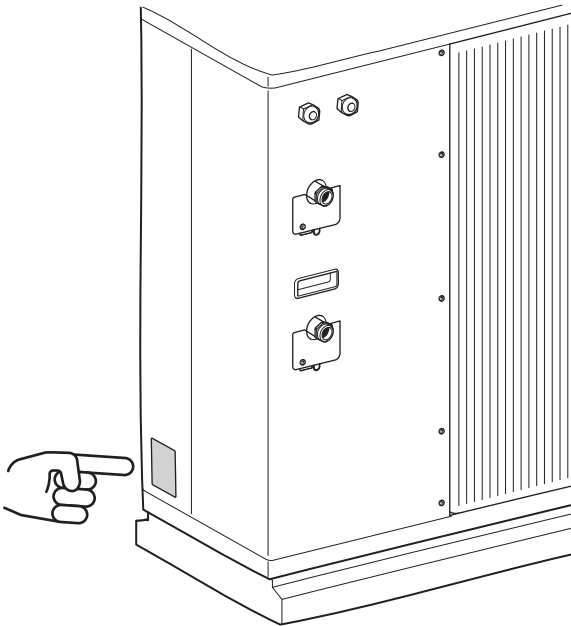


NOTE!

You need the product's serial number for servicing and support.

Installation function

An air/water heat pump installation uses the outdoor air to heat up a home. The conversion of the outdoor air's energy into residential heating occurs in three different circuits. From the outdoor air, (1), free heat energy is retrieved and

transported to the heat pump. The heat pump increases the retrieved heat's low temperature to a high temperature in the refrigerant circuit, (2). The heat is distributed around the building in the heating medium circuit, (3).

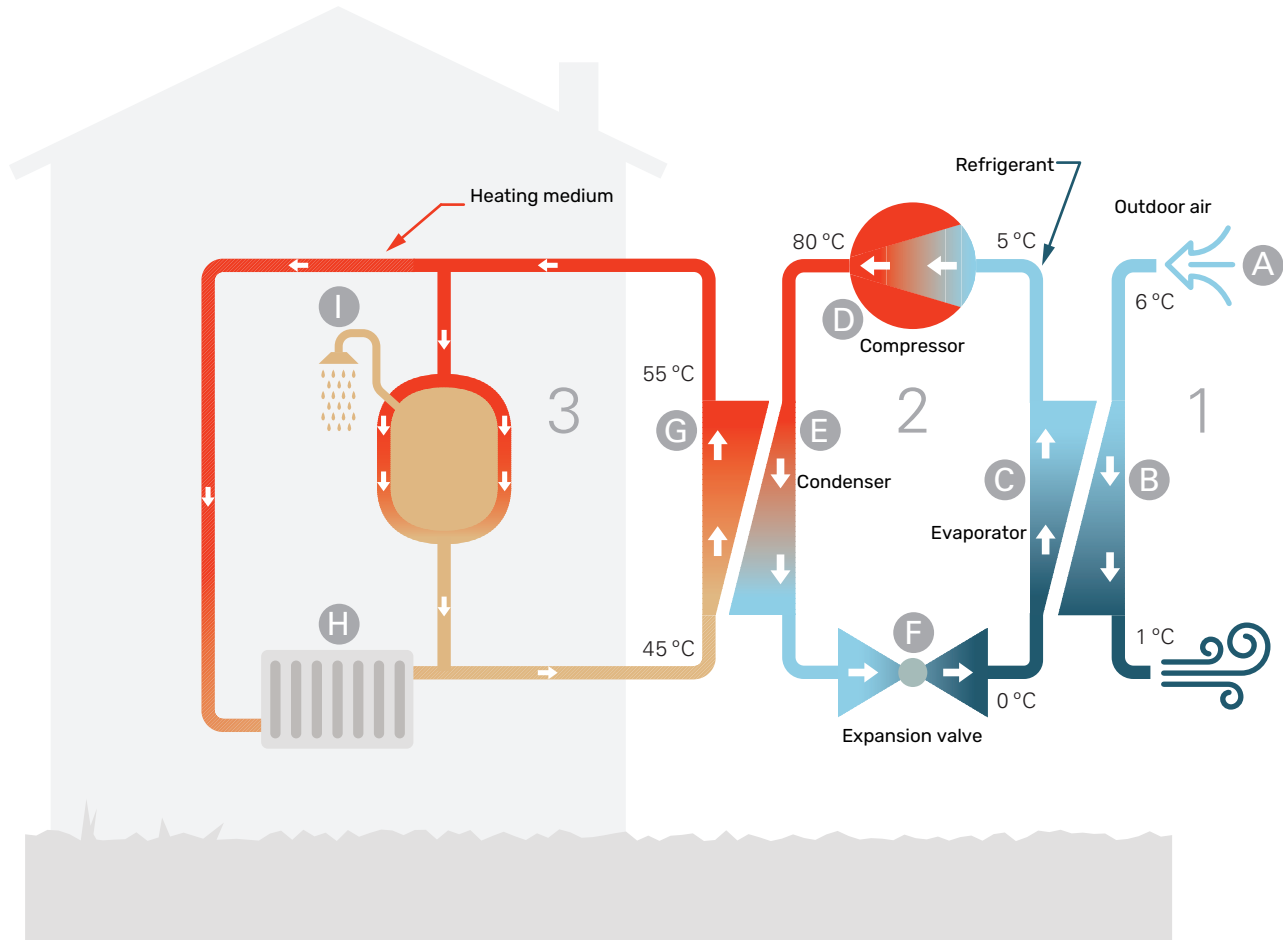

The temperatures are only examples and may vary between different installations and time of year.

Outdoor air

- A** The outdoor air is drawn into the outdoor unit.
- B** The fan then routes the air to the outdoor unit's evaporator. Here, the air releases thermal energy to the refrigerant and the air's temperature drops. The cold air is then blown out of the outdoor unit.

Refrigerant circuit

- C** In a closed system in the outdoor unit, a gas (a refrigerant) circulates, which also passes the evaporator. The refrigerant has a very low boiling point. In the evaporator, the refrigerant collects the heat energy from the outdoor air and starts to boil.
- D** The gas that is produced during boiling is routed into an electrically powered compressor. When the gas is compressed, the pressure increases and the gas's temperature increases considerably, from 0 °C to approx 80 °C.
- E** From the compressor, gas is forced into a heat exchanger, condenser, where it releases heat energy to the indoor module, whereupon the gas is cooled and condenses to a liquid form again.
- F** As the pressure is still high, the refrigerant can pass an expansion valve, where the pressure drops so that the refrigerant returns to its original temperature. The refrigerant has now completed a full cycle. It is routed to the evaporator again and the process is repeated.

Heat medium circuit

- G** The heat energy that the refrigerant produces in the condenser is retrieved by the indoor unit's heating medium, water, which is heated to approx. 55 °C (supply temperature).
- H** The heating medium circulates in a closed system and transports the heated water's heat energy to the house radiators/heating coils.
- I** The indoor module's integrated charge coil is placed in the boiler section. The water in the coil heats up the surrounding domestic hot water.

Control of F2050

F2050 is controlled in different ways, depending on your system. You control the heat pump via your indoor module or control module.

See the Installer Manual for the indoor module/control module.

During installation, the installation engineer adjusts the necessary settings for the heat pump in the indoor module or control module, so that the heat pump works optimally in your system.

Maintenance of F2050

Regular checks

When your heat pump is located outdoors some external maintenance is required.



CAUTION!

Insufficient maintenance can cause serious damage to F2050, which is not covered by the guarantee.

CHECKING GRILLES AND BOTTOM PANEL ON F2050

Check regularly throughout the year that the grille is not clogged by leaves, snow or anything else.


You should be particularly vigilant during windy conditions and/or in the event of snow, as the grille can become blocked.

Check that the back is free from dirt and leaves.


Also check that the drain holes in the bottom panel are free from dirt and leaves.

Regularly check that condensation is routed away correctly through the condensation pipe. Ask your installer for assistance if required.

Keep free of snow and ice

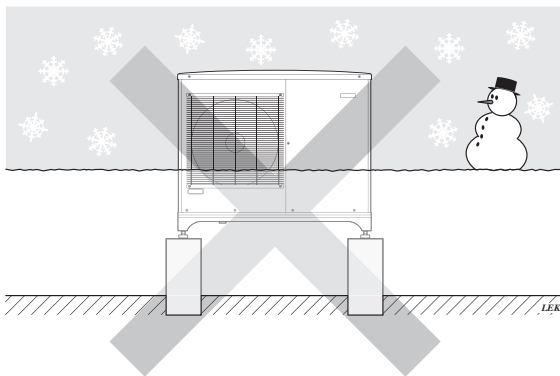

Prevent snow building up and covering the grille on F2050.

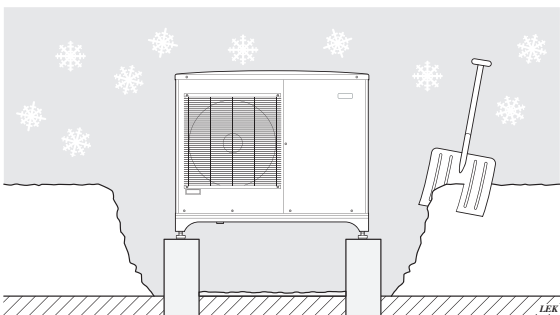

Keep free of snow and/or ice.

CLEANING THE OUTER CASING

If necessary the outer casing can be cleaned using a damp cloth.

Care must be exercised so that the heat pump is not scratched when cleaning. Avoid spraying water into the grilles or the sides so that water penetrates into F2050. Prevent F2050 coming into contact with alkaline cleaning agents.

In event of long power cuts

In the event of prolonged power failures, it is recommended that the part of the heating system located outdoors is drained. This is made easier if shut-off and draining valves are installed. Ask your installer if you are unsure.

Silent mode

The heat pump can be set to "Silent mode", which reduces the heat pump's noise level. This function can help when F2050¹ has to be placed in noise-sensitive areas. The function should only be used for limited periods, because F2050 might not reach its dimensioned power.

Updating the software

Information about updating software can be found in the Installer Manual for your indoor module or control module.

¹ F2050-12 always goes in "Silent mode".

Disturbances in comfort

In most cases, the indoor module/control module notes a malfunction (a malfunction can lead to disturbance in comfort) and indicates this with alarms and action instructions in the display.



CAUTION!

Work behind covers secured by screws may only be carried out by, or under the supervision of, a qualified installation engineer.

Troubleshooting

If the operational interference is not shown in the display the following tips can be used:

BASIC ACTIONS

- Group and main fuses of the accommodation.
- The property's earth circuit breaker.
- Make sure that the air flow to F2050 is not blocked by foreign objects.
- Check that F2050 does not have any external damage.

ICE BUILD-UP IN THE FAN, GRILLE AND/OR FAN CONE

Set the "Fan de-icing" function in the indoor module/control module. For more information, see the section "Control – Heat pump EB101" in the Installer Manual.

If problems arise, contact your installer.

WATER BELOW F2050 (LARGER AMOUNT)

- Fit accessory KVR to divert condensation from the air/water heat pump.
- Check that the water drainage via the condensation pipe (KVR) is working.

Contact information

AUSTRIA

KNV Energietechnik GmbH
Gahberggasse 11, 4861 Schörfling
Tel: +43 (0)7662 8963-0
mail@knv.at
knv.at

FINLAND

NIBE Energy Systems Oy
Juurakkotie 3, 01510 Vantaa
Tel: +358 (0)9 274 6970
info@nibe.fi
nibe.fi

GREAT BRITAIN

NIBE Energy Systems Ltd
3C Broom Business Park,
Bridge Way, S41 9QG Chesterfield
Tel: +44 (0)330 311 2201
info@nibe.co.uk
nibe.co.uk

POLAND

NIBE-BIAWAR Sp. z o.o.
Al. Jana Pawla II 57, 15-703 Białystok
Tel: +48 (0)85 66 28 490
biawar.com.pl

CZECH REPUBLIC

Družstevní závody Dražice - strojírna
s.r.o.
Dražice 69, 29471 Benátky n. Jiz.
Tel: +420 326 373 801
nibe@nibe.cz
nibe.cz

FRANCE

NIBE Energy Systems France SAS
Zone industrielle RD 28
Rue du Pou du Ciel, 01600 Reyrieux
Tél: 04 74 00 92 92
info@nibe.fr
nibe.fr

NETHERLANDS

NIBE Energietechnik B.V.
Energieweg 31, 4906 CG Oosterhout
Tel: +31 (0)168 47 77 22
info@nibenl.nl
nibenl.nl

SWEDEN

NIBE Energy Systems
Box 14
Hannabadsvägen 5, 285 21 Markaryd
Tel: +46 (0)433-27 30 00
info@nibe.se
nibe.se

DENMARK

Vølund Varmeteknik A/S
Industrivej Nord 7B, 7400 Herning
Tel: +45 97 17 20 33
info@volundvt.dk
volundvt.dk

GERMANY

NIBE Systemtechnik GmbH
Am Reiherpfahl 3, 29223 Celle
Tel: +49 (0)5141 75 46 -0
info@nibe.de
nibe.de

NORWAY

ABK-Qviller AS
Brobekkeveien 80, 0582 Oslo
Tel: (+47) 23 17 05 20
post@abkqviller.no
nibe.no

SWITZERLAND

NIBE Wärmetechnik c/o ait Schweiz AG
Industriepark, CH-6246 Altishofen
Tel. +41 (0)58 252 21 00
info@nibe.ch
nibe.ch

For countries not mentioned in this list, contact NIBE Sweden or check nibe.eu for more information.

NIBE Energy Systems
Hannabadsvägen 5
Box 14
SE-285 21 Markaryd
info@nibe.se
nibe.eu

UHB EN 2344-1 731678

This is a publication from NIBE Energy Systems. All product illustrations, facts and data are based on the available information at the time of the publication's approval.

NIBE Energy Systems makes reservations for any factual or printing errors in this publication.

©2023 NIBE ENERGY SYSTEMS

