

The NIBE logo is displayed in a bold, red, sans-serif font within a white rectangular box. The background of the entire page features a photograph of a dense forest with tall, thin trees and sunlight filtering through the canopy, creating a misty or ethereal atmosphere.

NIBE

Air/water heat pump

NIBE S2125

NIBE S2125 is an intelligent inverter controlled air/water heat pump. With NIBE indoor modules, it forms a highly efficient climate system for your home. The heat pump operates with a natural refrigerant for a sustainable impact on the climate and the environment. It provides optimised savings because it automatically adapts to the home's power needs.

NIBE S2125 has an optimised annual heating factor, which provides a low operating cost and hot water with high performance. The working area provides a single-flow temperature of up to 75 °C. At an outdoor temperature of down to -25 °C, up to 65 °C is still delivered, while the sound level is low.


Together with the NIBE S-series indoor module with built-in wifi connection and the possibility of wireless accessories, it becomes a natural part of your connected home. The smart technology automatically adjusts the indoor climate and gives you complete control of the system from your smartphone or tablet. High comfort and low energy consumption – at the same time as you do nature a favour.



- Optimised seasonal performance factor, low operating costs and high-performance hot water, using a natural refrigerant for a low environmental impact.
- Operating range up to 75 °C supply temperature and 65 °C at -25 °C outdoor temperature.
- New design for low noise level.

This is how NIBE S2125 works

Installation method

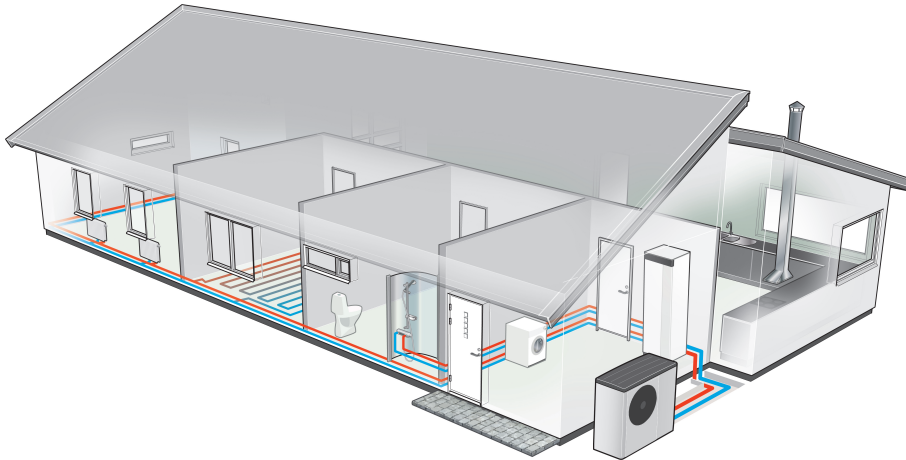

S2125 – a part of your climate system where S2125 is intended to be combined with one of the indoor modules or the control modules.


Together with an indoor module, S2125 creates a complete heating/cooling and hot water system. Our flexible indoor modules provide efficient heating and high hot water performance. The indoor modules are complete with a smart, user-friendly control system, hot water heater, additional heat, self-regulating circulation pump, etc.

The control modules offer a flexible system solution that can be easily customised. For systems with a control module, different components, such as water heaters, additional heat and other accessories, can be selected to suit the installation's requirements.

There is a wide range of system solutions and accessories for NIBE's indoor modules and control modules.

PRINCIPLE OF OPERATION

Principle of operation with indoor module, hot water and climate system.

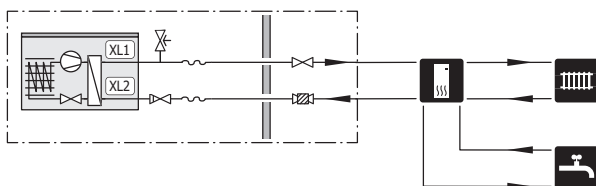

- XL1 Heating medium connection, supply (out from S2125)
- XL2 Heating medium connection, return (to S2125)

COMPATIBLE INDOOR MODULES AND CONTROL MODULES

	VVM S320	VVM S330	VVM S500	SMO S40
S2125-8	X	X	X	X
S2125-12	X	X	X	X
S2125-16	X		X	X
S2125-20			X	X

	VVM 225	VVM 310	VVM 500	SMO 20	SMO 40	MHB 05
S2125-8	X	X	X	X	X	X
S2125-12	X	X	X	X	X	X
S2125-16		X	X	X	X	
S2125-20			X	X	X	

INDOOR MODULES



VVM S320

Stainless steel, 1x230 V
Part no. 069 198

VVM S320

Enamel, 3x400 V
Part no. 069 206

VVM S320

Copper, 3x400 V
Part no. 069 195

VVM S330

Stainless steel, 3 x 400 V
Part no. 069 250

VVM S500

Stainless steel, 3x400 V
Part no. 069 276

VVM S320

Stainless steel, 3x230 V
Part no. 069 201

VVM S320

Stainless steel, 3x400 V
Part no. 069 196

VVM S330

Stainless steel, 1 x 230 V
Part no. 069 249

VVM S500

Stainless steel, 1x230 V
Part no. 069 277



VVM 225¹

Stainless steel, 1x230 V
Part no. 069 231

VVM 225¹

Enamel, 3x400 V
Part no. 069 227

VVM 310

Stainless steel, 3x400 V
Part no. 069 430

VVM 500

Stainless steel, 3x400 V
Part no. 069 400

VVM 225¹

Stainless steel, 3x230 V
Part no. 069 230

VVM 225¹

Stainless steel, 3x400 V
Part no. 069 229

VVM 310

Stainless steel, 3x400 V
With integrated EMK 310
Part no. 069 084

¹ In combination with S2125-12, the system must be supplemented with NIBE UKV.

MONOBLOC HYDRO BOX

MHB 05¹

Part no. 067 942

CONTROL MODULES

SMO S40

Control module
Part no. 067 654

SMO 20

Control module
Part no. 067 224

SMO 40

Control module
Part no. 067 225



Good to know about NIBE S2125

Transport

S2125 should be transported and stored vertically in a dry place.

Ensure that the heat pump cannot fall over during transport.

Check that S2125 has not been damaged during transport.

LIFT FROM THE STREET TO THE SET UP LOCATION


If the surface allows, the easiest method is to use a pallet truck to move the heat pump to the installation area.

The centre of gravity is offset to one side (see print on the packaging).

LIFT FROM THE PALLET TO FINAL POSITIONING

Before lifting remove the packaging and the securing strap to the pallet.

Place lifting straps around each foot. Four people are recommended for lifting from the pallet to the foundation, one for each lifting strap.

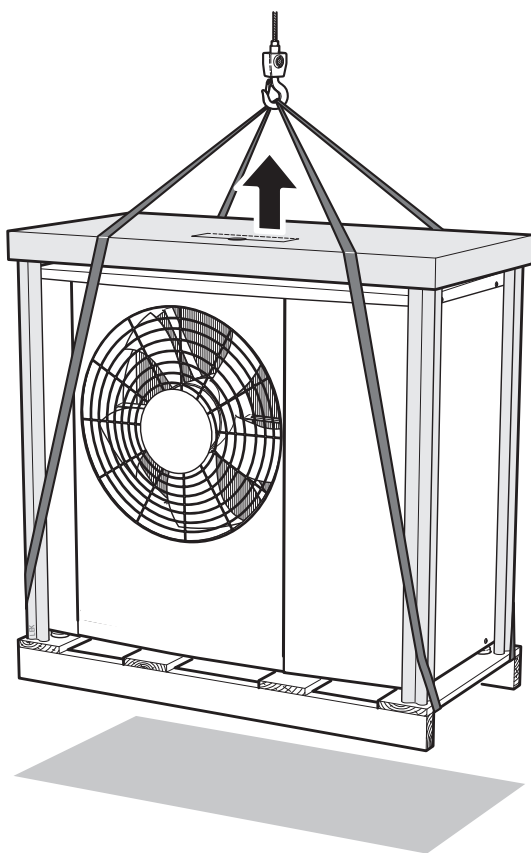


If the heat pump needs to be transported across soft ground, such as a lawn, we recommend using a crane truck that can lift it to the installation location. When the heat pump is lifted with a crane, the packaging must be intact.

If a crane truck cannot be used, the heat pump can be transported on an extended sack truck. The heat pump must be taken hold of from its heaviest side and two people are required to lift it.

Installation and positioning

- Place the heat pump in a suitable location outdoors to prevent any risk of the refrigerant flowing in through ventilation openings, doors or similar openings in the event of a leak. It must also not constitute a hazard to people or property in any other way.
- If the heat pump is placed in a location where any refrigerant leak could accumulate, for example below ground level (in a dip or low-lying recess), the installation must satisfy the same requirements that apply for gas detection and the ventilation of engineering rooms. Requirements regarding sources of ignition must be applied where appropriate.
- Place S2125 outdoors on a solid level base that can take the weight, preferably a concrete foundation. If concrete slabs are used they must rest on asphalt or shingle.
- S2125 should not be positioned next to noise sensitive walls, for example, next to a bedroom.
- Also ensure that the placement does not inconvenience the neighbours.
- S2125 must not be placed so that recirculation of the outdoor air is possible. Recirculation entails reduced power and impaired efficiency.
- The evaporator must be sheltered from direct wind / , which negatively affects the defrosting function. Place S2125 protected from wind / against the evaporator.
- Small amounts of condensation water, as well as melt water from defrosting, may be produced. Condensation water must be led off to a drain or equivalent.

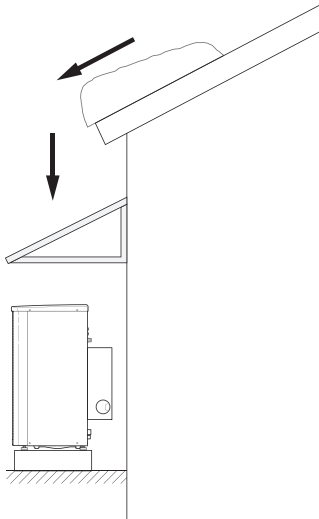

If there is a risk of snow slip from roof, a protective roof or cover must be erected to protect the heat pump, pipes and wiring.


Installation area

Leave a free space of at least 350 mm between S2125 and the house wall, but not more than 500 mm in windy locations.

Leave a free space of 1,000 mm in front of, and 1,000 mm above, the product.

Approx. 600 mm free space is required on the right-hand side to allow the side panel to be removed.


The lower edge of the evaporator must not be lower than the level of the average local snow depth, or at least 300 mm above ground level. The base should be at least 70 mm tall.

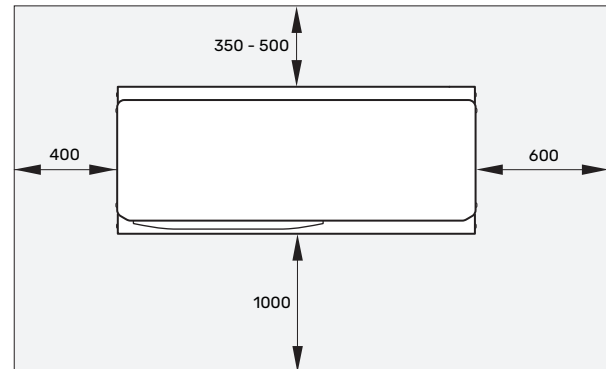


Supplied components

Local differences in the enclosed kit may occur. See relevant installer manual for more information.


S2125-8/-12




1 x filterball (G1")




1 x non-return valve



1 x automatic gas separator




1 x flexible pipe with bend
1 x flexible pipe
(Dimensions, flexible pipes
DN25, G1")
4 x gaskets




2 x labels for external control
voltage of the control system

S2125-16/-20




1 x filterball (G1¼")




1 x non-return valve



1 x automatic gas separator



1 x flexible pipe with bend
1 x flexible pipe
(Dimensions, flexible pipes
DN25, G1¼")
4 x gaskets



2 x labels for external control
voltage of the control system

Installation

Inspection of the installation

Current regulations require the heating installation to be inspected before it is commissioned. The inspection must be carried out by a suitably qualified person and must be documented. The above applies to closed heating systems.

If the heat pump is replaced, the installation must be inspected again.

Condensation water trough

The condensate drain pan collects and leads away the condensation water.

It is important to the heat pump function that condensation water is led away and that the drain for the condensation water run off is not positioned so that it can cause damage to the house.

Condensation run-off should be checked regularly, especially during the autumn. Clean if necessary.

Pipe, with heating cable, for draining the condensate drip tray is not included. To guarantee the function, the accessory KVR should be used.

- The condensation water (up to 50 litres/24 hrs) that collects in the trough should be routed away by a pipe to an appropriate drain, it is recommended that the shortest outdoor stretch possible is used.
- The section of the pipe that can be affected by frost must be heated by the heating cable to prevent freezing.

Pipe with heating cable for draining the condensation water trough is not included.

To ensure this function, the accessory KVR should be used.

- Route the pipe downward from the heat pump.
- The outlet of the condensation water pipe must be at frost free depth.
- Use a water trap for installations where air circulation may occur in the condensation water pipe.
- The insulation must seal against the bottom of the condensation water trough.

DRAINAGE OF CONDENSATION

If none of the following recommended alternatives is used, good drainage of condensation must be provided.

Stone caisson

If the house has a cellar the stone caisson must be positioned so that condensation water does not affect the house. Otherwise the stone caisson can be positioned directly under the heat pump.

Gutter drainage

Route the pipe sloping down from the heat pump. The condensation water pipe must have a water seal to prevent air circulation in the pipe.

Pipe connections

MINIMUM SYSTEM FLOWS

An undersized climate system can result in damage to the product and lead to malfunctions.

Each climate system must be dimensioned individually to provide the recommended system flows.

The installation must be dimensioned to provide at least the minimum defrosting flow at 100 % circulation pump operation.

Air/water heat pump	Minimum flow during defrosting 100% circulation pump operation (l/s)	Minimum recommended pipe dimension (DN)	Minimum recommended pipe dimension (mm)
S2125-8	0.32	25	28
S2125-12			
S2125-16	0.38	32	35
S2125-20	0.48		

S2125 can only operate up to a return temperature of about 65 °C and an outgoing temperature of about 75 °C from the heat pump.


WATER VOLUMES

To prevent short operating times, and to enable defrosting, a certain available water volume is required. For the optimum operation of S2125, a minimum available water volume is recommended, see table. This applies separately to heating and cooling systems.

Air/water heat pump	Water volume (litres)
S2125-8/-12	120
S2125-16	160
S2125-20	200

Electrical connections

- Electrical installation and wiring must be carried out in accordance with national provisions.
- Prior to insulation testing the house wiring, disconnect the air/water heat pump installation.
- If a miniature circuit breaker is used, this must have at least triggering characteristic "C". See section "Technical specifications" in the Installer Manual for S2125.
- S2125 must be fitted with a residual current device. If the property is equipped with a residual current device, S2125 must be equipped with a separate one.
- The RCD must have a nominal tripping current of no more than 30 mA.
- S2125 must be installed via an isolator switch. The cable area has to be dimensioned based on the fuse rating used.
- Use a screened cable for communication.
- To prevent interference, communication cables to external connections must not be laid in the vicinity of high voltage cables.
- Connect the charge pump to the control module. See where the charge pump is to be connected in the Installer Manual for your control module.
- When cable routing in S2125, the cable grommets (UB1 and UB2) must be used.

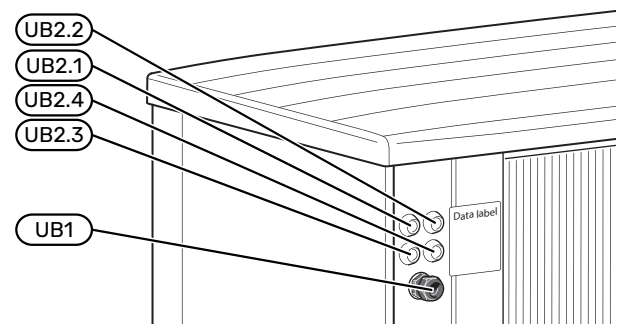

Functions

When connection to NIBE indoor module / control module (VVM / SMO) is ready, you can control your unit via the indoor module / control module.

Control, general

The indoor temperature depends on several different factors. Sunlight and heat emissions from people and household machines are normally sufficient to keep the house warm during the warm seasons. When it gets colder outside, the climate system needs to help heat the house. The colder it is outside, the warmer radiators and underfloor heating systems have to be.

Control of the heat production is performed based on the "floating condensing" principle, which means that the temperature level needed for heating at a specific outdoor temperature is produced based on collected values from the outdoor and supply temperature sensors. The room sensor can also be used to compensate the deviation in room temperature.

Heat production



The supply of heating/cooling to the house is regulated in accordance with the selected heating curve setting (or cooling curve). After adjustment, the correct amount of heat for the current outdoor temperature is supplied. The supply temperature will oscillate around the theoretically desired value.

OWN CURVE

The indoor module/control module have pre-programmed, non-linear heating curves. It is also possible to create your own defined curve. This is a partially linear curve with a number of break points. You select break points and the associated temperatures.

Hot water production



Hot water charging starts when the temperature has fallen to the set start temperature. Hot water charging stops when the hot water temperature at the hot water sensor has been reached.

For temporary higher hot water demand, there is a function that allows the temperature to be raised temporarily for up to 12 hours or by a one time increase (can be selected in the menu system).

It is also possible to put the installation in holiday mode, which means that the lowest possible temperature is maintained without the risk of freezing.

Additional heat only



The indoor module, which is connected to S2125, can be used with the additional heat alone (electric boiler) to produce heating and hot water, for example before the outdoor unit is installed.

Alarm indications



If there is an alarm, the status lamp lights up red on the indoor module's / control module's display. Detailed information, depending on the fault, is shown in the display. An alarm log is created for each alarm, containing a number of temperatures, times and operating status.

The display



The indoor module / control module (HWM / SMO) is controlled using a clear and easy-to-use display.

Instructions, settings and operational information are shown on the display. You can easily navigate between the different menus and options to set the comfort or obtain the information you require.

myUplink



With myUplink you can control the installation – where and when you want. In the event of any malfunction, you receive an alarm directly to your e-mail or a push notification to the myUplink app, which allows you to take prompt action.

Visit myuplink.com for more information.

SPECIFICATION

You need the following in order for myUplink to be able to communicate with your system:

- wireless network or network cable
- Internet connection
- account on myuplink.com

We recommend our mobile apps for myUplink.

RANGE OF SERVICES

myUplink gives you access to various levels of service. The base level is included and, apart from this, you can choose two premium services for a fixed annual fee (the fee varies depending on the functions selected).

Service level	Basic	Premium extended history	Premium change settings
Viewer	X	X	X
Alarm	X	X	X
History	X	X	X
Extended history	-	X	-
Manage	-	-	X

MOBILE APPS FOR MYUPLINK

The mobile apps can be downloaded free of charge from where you usually download your mobile apps. Logging into the mobile app is performed using the same account details as on myuplink.com.

MYUPLINK PRO

myUplink PRO is a complete tool for offering service agreements to the end customer and for always having the latest information about the installation, as well as the option to adjust settings remotely.

With myUplink PRO, you can provide your connected customers with rapid status and remote diagnostics.

Visit pro.myuplink.com for information about what else you can do using the mobile app and online.

NIBE SMART PRICE ADAPTION™



Smart Price Adaption is not available in all countries. Contact your NIBE dealer for more information.

Smart Price Adaption adjusts the system's consumption according to the time of day when electricity prices are lowest. This allows for savings, provided that an hourly rate subscription has been signed with the electricity supplier.

The function is based on hourly rates for the coming day being downloaded via myUplink. To use the function, an Internet connection and account on myUplink are necessary.

WIRELESS UPDATES



When the system is connected, there is the option to receive wireless updates. This provides the system with new functions, giving a better experience.

To receive wireless updates, you have to create an account on myUplink.

SMART HOME

When you have a smart home system that can communicate with myUplink, you can control the installation via an app by activating the "smart home" function.

By allowing connected units to communicate with myUplink, your heating system becomes a natural part of your homesmart home and gives you the opportunity to optimise the operation.

Remember that the "smart home" function requires myUplink in order to work.

NIBE SMART ENERGY SOURCE™




Smart Energy Source™ prioritises how / to what extent each docked energy source will be used.

Here you can choose if the system is to use the energy source that is cheapest at the time. You can also choose if the system is to use the energy source that is most carbon neutral at the time.


Technical data

Dimensions


S2125-8, -12

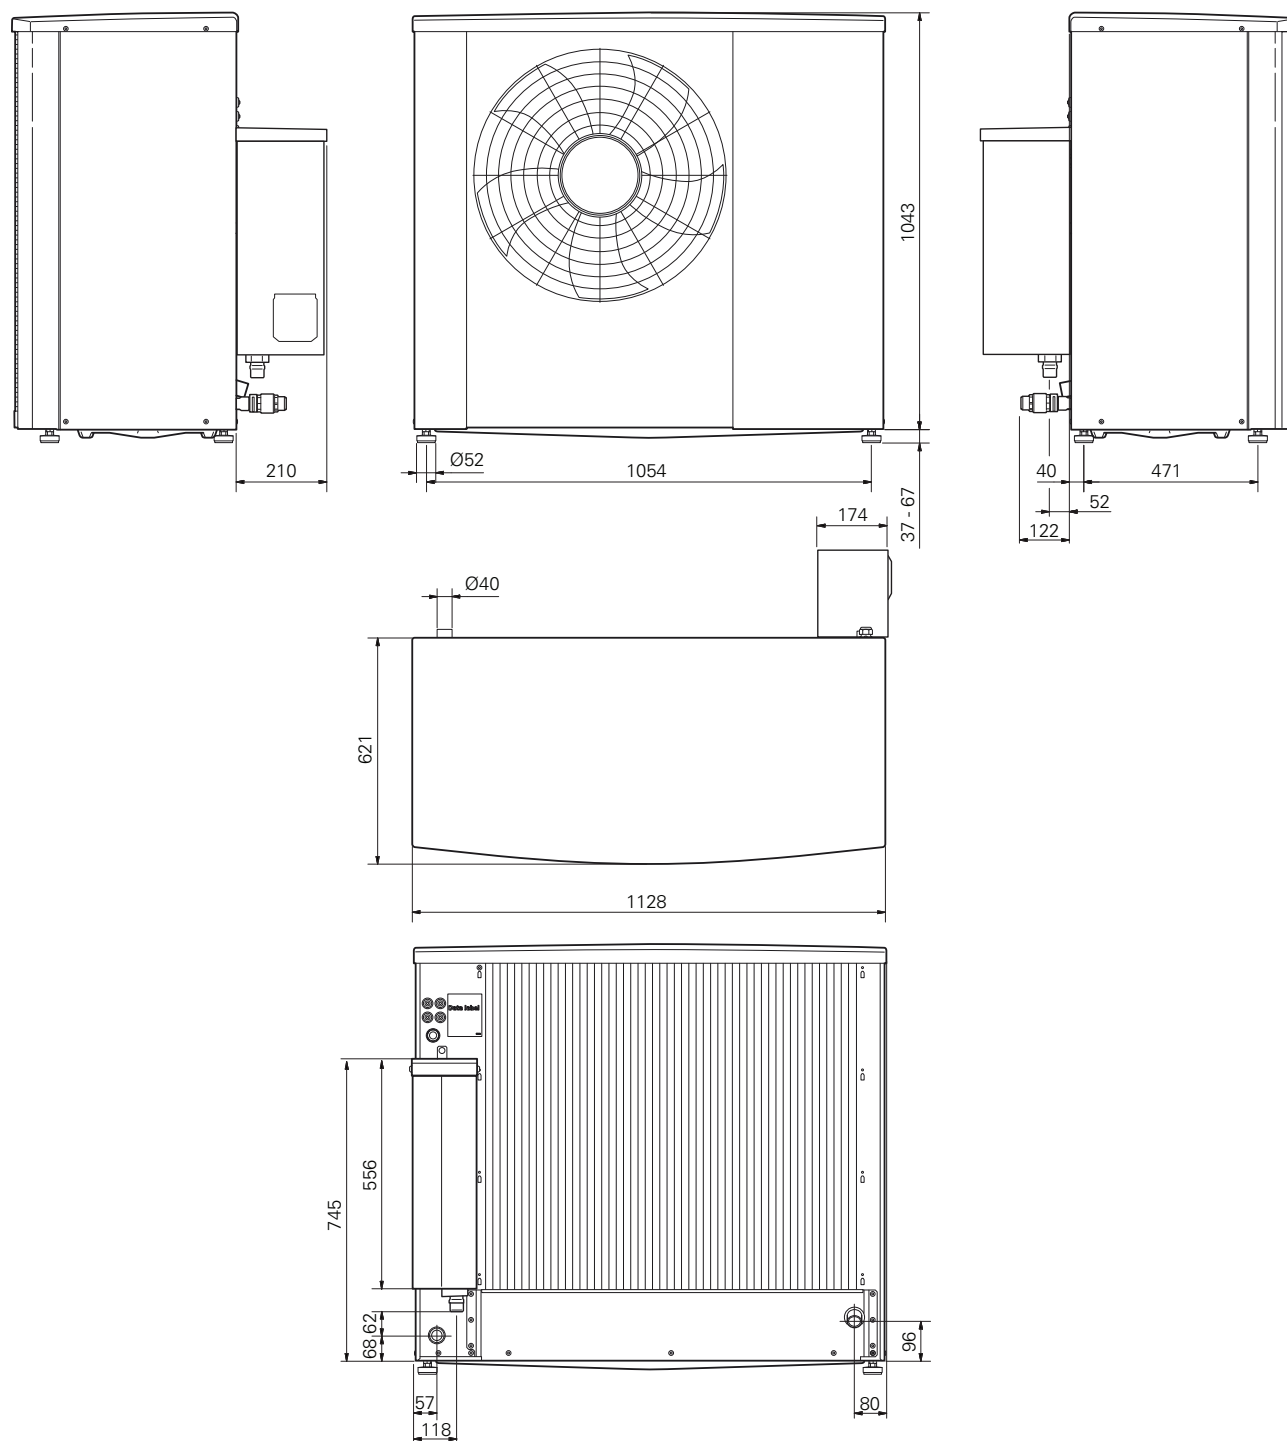

S2125-16, -20

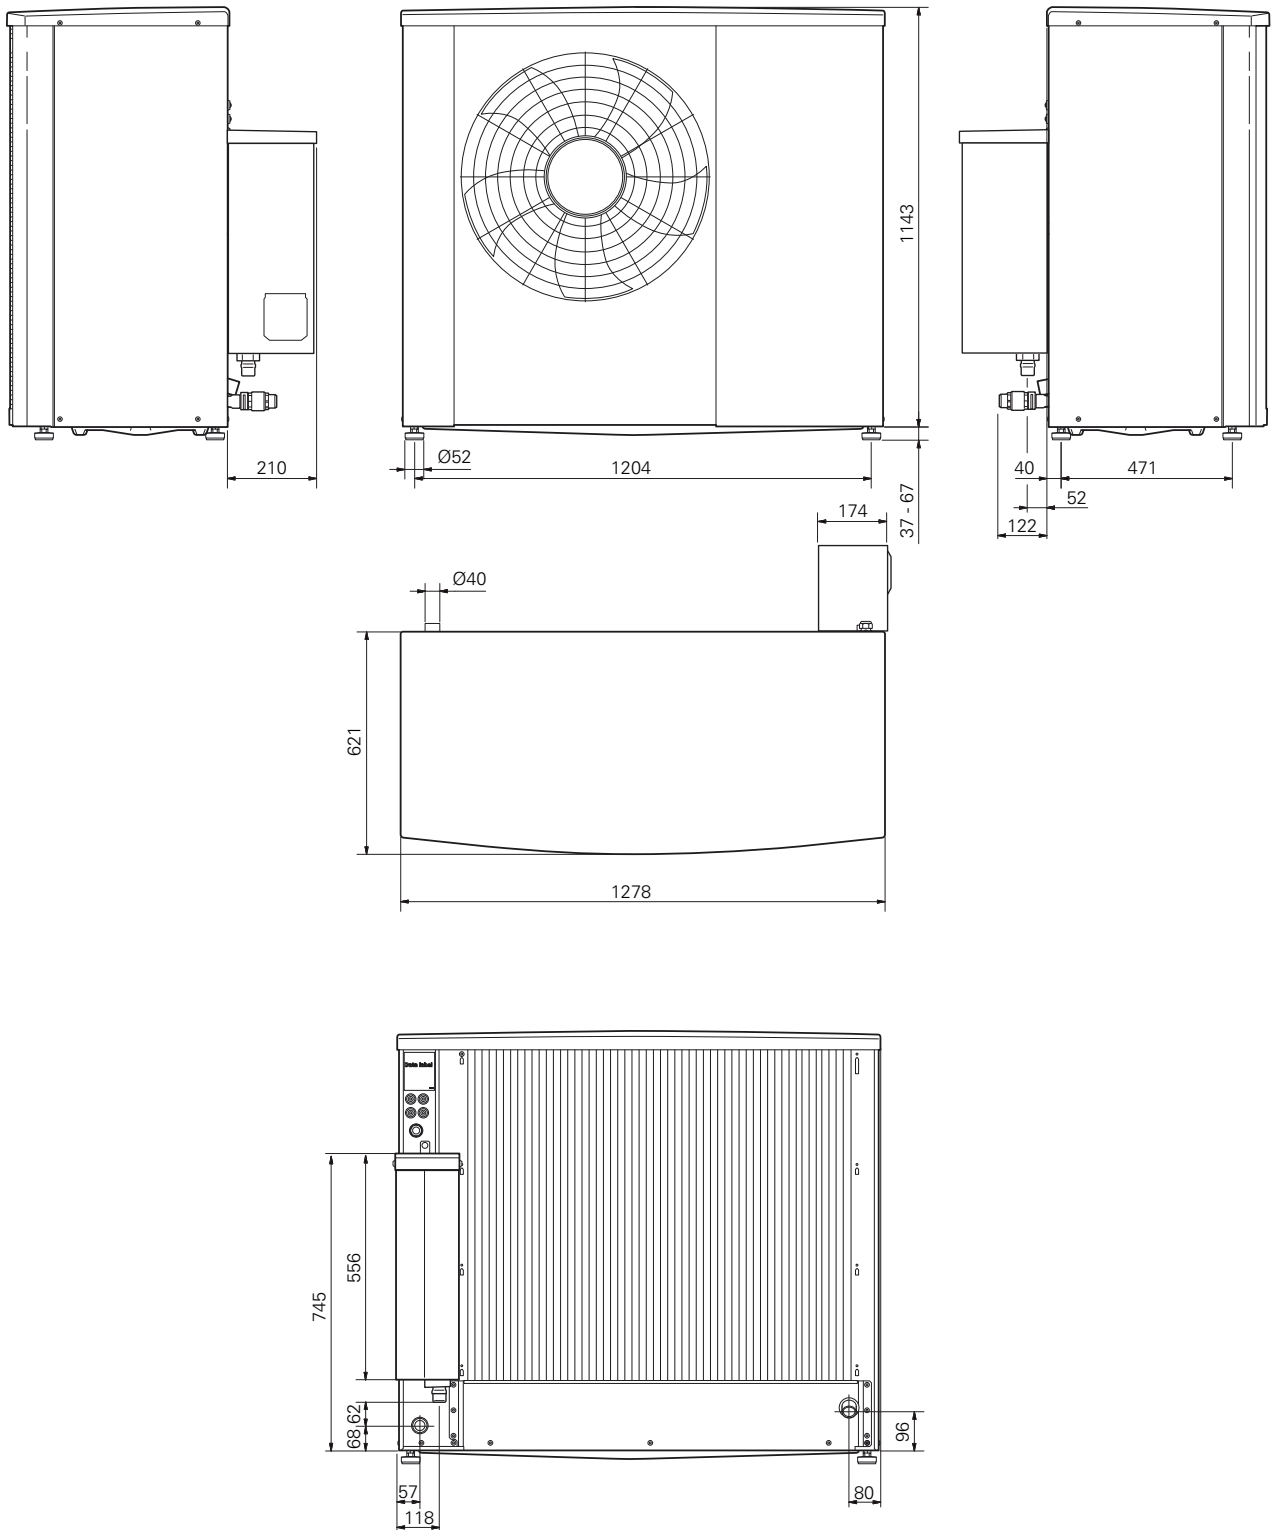

Sound levels

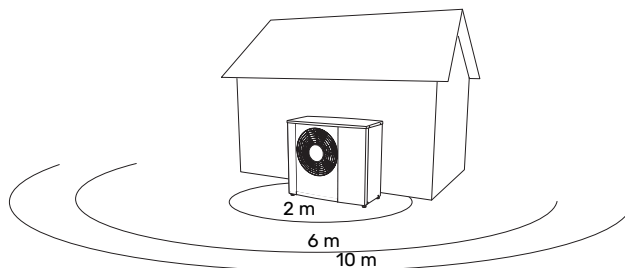

S2125 is usually placed next to a house wall, which gives a directed sound distribution that has to be taken into consideration. Accordingly, when setting up, you should always attempt to select the side that faces the least sound-sensitive neighbouring area.

The sound pressure levels are further affected by walls, bricks, differences in ground level, etc and should therefore only be seen as guide values.

		Sound power ¹	Sound pressure at distance (m) ²									
			1	2	3	4	5	6	7	8	9	10
S2125-8	Nominal sound value	49	44.0	38.0	34.5	32.0	30.0	28.5	27.0	26.0	25.0	24.0
	Max. sound value	55	50.0	44.0	40.5	38.0	36.0	34.5	33.0	32.0	31.0	30.0
	Max. sound value, silent mode	50	45.0	39.0	35.5	33.0	31.0	29.5	28.0	27.0	26.0	25.0
S2125-12	Nominal sound value	49	44.0	38.0	34.5	32.0	30.0	28.5	27.0	26.0	25.0	24.0
	Max. sound value	59	54.0	48.0	44.5	42.0	40.0	38.5	37.0	36.0	35.0	34.0
	Max. sound value, silent mode	54	49.0	43.0	39.5	37.0	35.0	33.5	32.0	31.0	30.0	29.0
S2125-16	Nominal sound value	55	50.0	44.0	40.5	38.0	36.0	34.5	33.0	32.0	31.0	30.0
	Max. sound value	60	55.0	49.0	45.5	43.0	41.0	39.5	38.0	37.0	36.0	35.0
	Max. sound value, silent mode	54	49.0	43.0	39.5	37.0	35.0	33.5	32.0	31.0	30.0	29.0
S2125-20	Nominal sound value	55	50.0	44.0	40.5	38.0	36.0	34.5	33.0	32.0	31.0	30.0
	Max. sound value	63	58.0	52.0	48.5	46.0	44.0	42.5	41.0	40.0	39.0	38.0
	Max. sound value, silent mode	55	50.0	44.0	40.5	38.0	36.0	34.5	33.0	32.0	31.0	30.0

¹ Sound power level, $L_W(A)$, according to EN12102


² Sound pressure calculated according to directivity factor $Q=4$

Technical specifications

WORKING RANGE, HEATING


S2125-8, -12

Supply temperature
(°C)

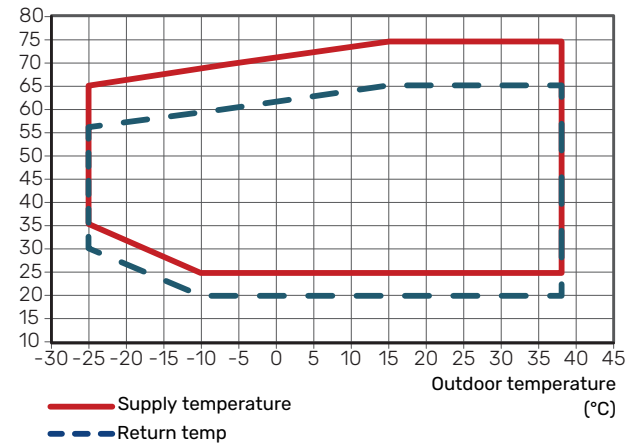

S2125-16, -20


Supply temperature
(°C)

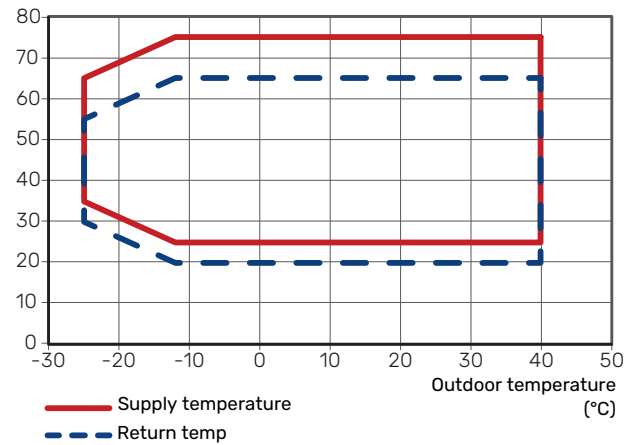

WORKING RANGE, COOLING


S2125-8, -12

Supply temperature
(°C)

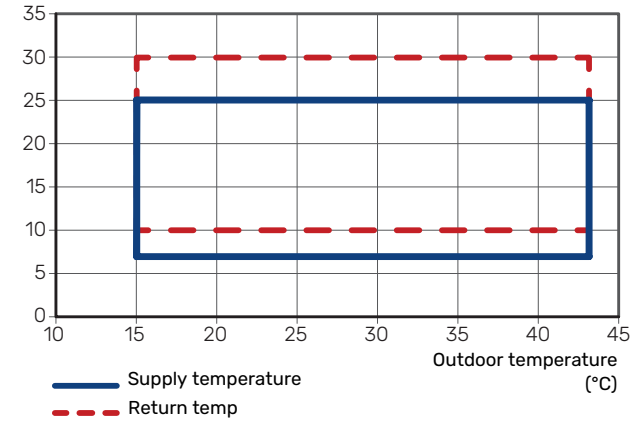

S2125-16, -20

Supply temperature
(°C)

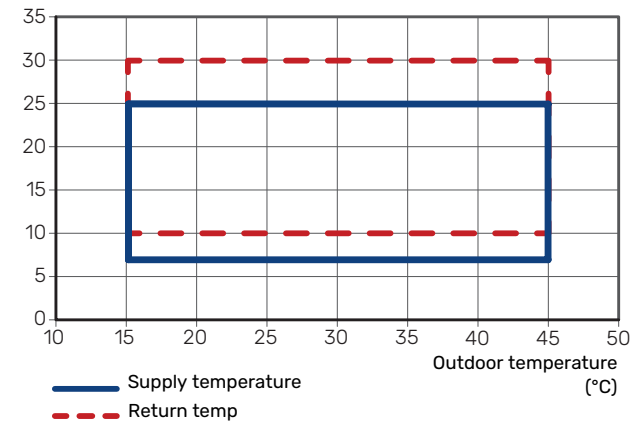


During shorter time it is allowed to have lower working temperatures on the water side, e.g. during start up.

POWER DURING HEATING OPERATION

Maximum and minimum capacity during continuous operation. Defrosting is not included.


S2125-8

Heating output
(kW)

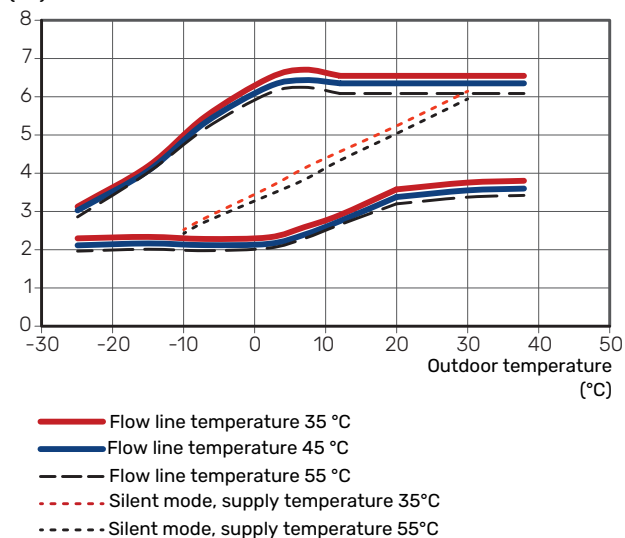


S2125-12

Heating output
(kW)

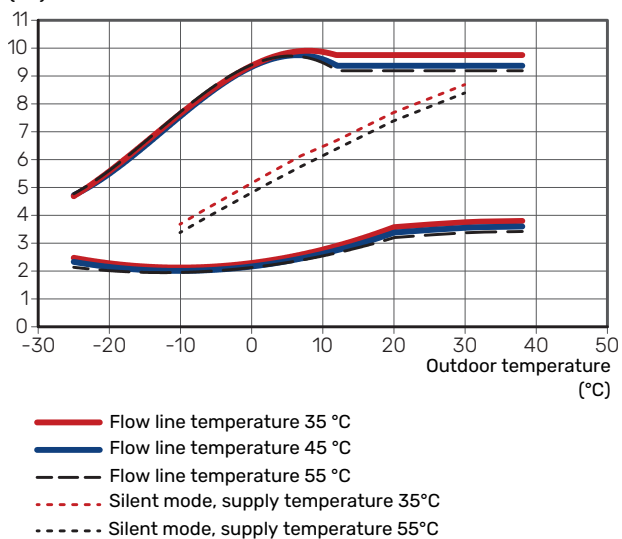


S2125-16

Heating output
(kW)

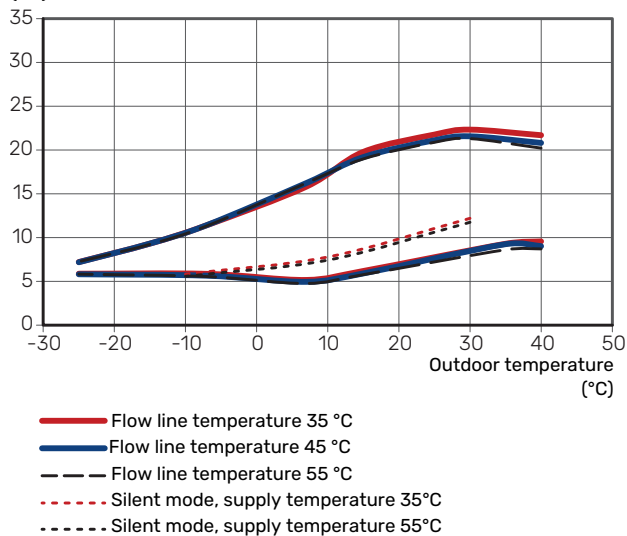

S2125-20

Heating output
(kW)

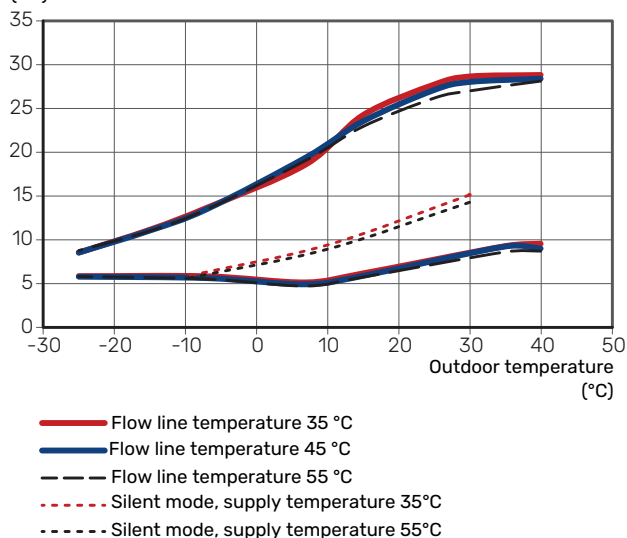


POWER DURING COOLING OPERATION

Maximum and minimum capacity during continuous operation.


S2125-8, -12

Cooling output
(kW)

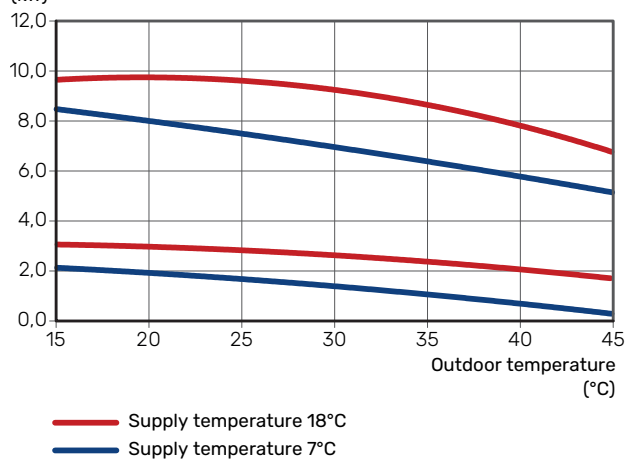

S2125-16, -20

Cooling output
(kW)

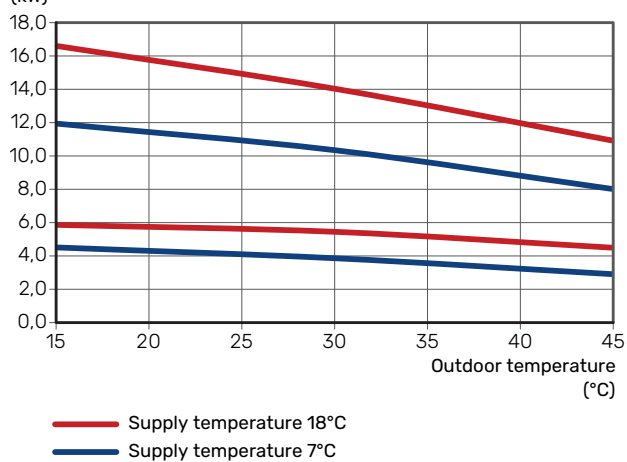

S2125		8	12
Voltage		1 x 230 V	1 x 230 V
Output data according to EN 14 511, partial load ¹			
Heating	-7 / 35 °C	4.72 / 1.72 / 2.74	7.23 / 2.73 / 2.65
Capacity / power input / COP (kW/kW/-) at nominal flow Outdoor temp: / Supply temp.	2 / 35 °C	3.20 / 0.72 / 4.44	3.67 / 0.85 / 4.32
	2 / 45 °C	2.95 / 0.87 / 3.39	3.46 / 1.02 / 3.40
	7 / 35 °C	3.15 / 0.61 / 5.16	3.67 / 0.70 / 5.24
	7 / 45 °C	2.97 / 0.76 / 3.90	3.35 / 0.85 / 3.94
Cooling	35 / 7 °C	6.69 / 2.41 / 2.77	6.69 / 2.41 / 2.77
Capacity / power input / EER (kW/kW/-) at maximum flow Outdoor temp: / Supply temp.	35 / 18 °C	8.68 / 2.60 / 3.34	8.68 / 2.60 / 3.34
SCOP according to EN 14825			
Nominal heat output (P _{designh}) average climate 35 °C / 55 °C (Europe)	kW	5.33 / 5.30	6.80 / 7.60
Nominal heat output (P _{designh}) cold climate 35 °C / 55 °C	kW	5.40 / 5.20	8.40 / 8.40
Nominal heat output (P _{designh}) warm climate 35 °C / 55 °C	kW	5.50 / 5.20	7.00 / 7.45
SCOP average climate, 35 °C / 55 °C (Europe)		5.00 / 3.70	5.00 / 3.80
SCOP cold climate, 35 °C / 55 °C		4.10 / 3.20	4.20 / 3.40
SCOP warm climate, 35 °C / 55 °C		6.30 / 4.50	6.30 / 4.60
Energy rating, average climate ²			
The product's room heating efficiency class 35 °C / 55 °C ³		A+++ / A++	A+++ / A+++
The system's room heating efficiency class 35 °C / 55 °C ⁴		A+++ / A+++	
Electrical data			
Rated voltage		230 V ~ 50 Hz	230 V ~ 50 Hz
Max. power, fan	W	30	50
Fuse	A _{rms}	16	20
Enclosure class		IP24	
Refrigerant circuit			
Type of refrigerant		R290	
GWP refrigerant		0.02	
Volume	kg	0.8	0.8
Type of compressor		Rotary compressor	Rotary compressor
CO ₂ -equivalent (The cooling circuit is hermetically sealed.)	t	0.000016	
Airflow			
Max airflow	m ³ /h	2,400	2,950
Working area			
Min./max. air temperature, heating	°C	-25 / 38	
Min./max. air temperature, cooling	°C	15 / 43	
Heating medium circuit			
Max system pressure heating medium	MPa	0.45 (4.5)	
Cut-off pressure, heating medium	MPa	0.25 (2.5)	
Recommended flow interval, heating operation	l/s	0.08 – 0.32	0.12 – 0.48
Min. design flow, defrosting (100% pump speed)	l/s	0.32	
Min./max. HM temp, continuous operation	°C	26 / 75	
Connection heating medium S2125		G1" external thread	
Connection heating medium flex pipe		G1" external thread	
Min. recommended pipe dimension (system)	DN (mm)	25 (28)	
Dimensions and weight			
Width	mm	1,128	1,128
Depth	mm	831	
Height	mm	1,080	1,080
Weight	kg	163	163
Miscellaneous			
Part no.		064 220	064 218
EPREL no.		108 98 05	108 97 19

¹ Power statements including defrosting according to EN 14511 at heating medium supply corresponding to DT=5 K at 7 / 45.

² The reported efficiency of the package also takes the controller into account. If an external supplementary boiler or solar heating is added to the package, the overall efficiency of the package should be recalculated.

³ Scale for the product's efficiency class room heating: A+++ to D.. Control module model SMO S.

⁴ Scale for the system's efficiency class room heating: A+++ to G. Reported efficiency for the system takes the product's temperature regulator into account.. Control module model SMO S.

S2125		8	12	16	20
Voltage		3 x 400 V	3 x 400 V	3 x 400 V	3 x 400 V
Output data according to EN 14 511, partial load ¹					
Heating	-7 / 35 °C	4.72 / 1.72 / 2.74	7.23 / 2.73 / 2.65	10.31 / 3.72 / 2.77	12.03 / 4.56 / 2.64
Capacity / power input / COP (kW/kW/-) at nominal flow	2 / 35 °C	3.20 / 0.72 / 4.44	3.67 / 0.85 / 4.32	6.58 / 1.41 / 4.66	7.38 / 1.59 / 4.63
Outdoor temp: / Supply temp.	2 / 45 °C	2.95 / 0.87 / 3.39	3.46 / 1.02 / 3.40	6.65 / 1.81 / 3.68	7.44 / 2.02 / 3.67
	7 / 35 °C	3.15 / 0.61 / 5.16	3.67 / 0.70 / 5.24	5.10 / 0.92 / 5.55	5.10 / 0.92 / 5.55
	7 / 45 °C	2.97 / 0.76 / 3.90	3.35 / 0.85 / 3.94	4.85 / 1.18 / 4.12	4.85 / 1.18 / 4.12
Cooling	35 / 7 °C	6.69 / 2.41 / 2.77	6.69 / 2.41 / 2.77	9.74 / 3.16 / 3.08	9.74 / 3.16 / 3.08
Capacity / power input / EER (kW/kW/-) at maximum flow	35 / 18 °C	8.68 / 2.60 / 3.34	8.68 / 2.60 / 3.34	13.62 / 3.46 / 3.93	13.62 / 3.46 / 3.93
Outdoor temp: / Supply temp.					
SCOP according to EN 14825					
Nominal heat output (P _{designh}) average climate 35 °C / 55 °C (Europe)	kW	5.33 / 5.30	6.80 / 7.60	11.00 / 11.00	11.00 / 11.00
Nominal heat output (P _{designh}) cold climate 35 °C / 55 °C	kW	5.40 / 5.20	8.40 / 8.40	13.00 / 14.00	13.00 / 14.00
Nominal heat output (P _{designh}) warm climate 35 °C / 55 °C	kW	5.50 / 5.20	7.00 / 7.45	13.00 / 13.00	13.00 / 13.00
SCOP average climate, 35 °C / 55 °C (Europe)		5.00 / 3.70	5.00 / 3.80	5.33 / 4.08	5.30 / 4.08
SCOP cold climate, 35 °C / 55 °C		4.10 / 3.20	4.20 / 3.40	4.47 / 3.59	4.60 / 3.69
SCOP warm climate, 35 °C / 55 °C		6.30 / 4.50	6.30 / 4.60	5.98 / 4.79	6.29 / 4.78
Energy rating, average climate ²					
The product's room heating efficiency class 35 °C / 55 °C ³		A+++ / A++	A+++ / A+++	A+++ / A+++	A+++ / A+++
The system's room heating efficiency class 35 °C / 55 °C ⁴		A+++ / A+++			
Electrical data					
Rated voltage		400 V 3N ~ 50 Hz	400 V 3N ~ 50 Hz	400 V 3N ~ 50 Hz	400 V 3N ~ 50 Hz
Max. power, fan	W	30	50	43	69
Fuse	A _{rms}	6	10	10	16
Enclosure class		IP24			
Refrigerant circuit					
Type of refrigerant		R290			
GWP refrigerant		0.02			
Volume	kg	0.8	0.8	1.15	1.15
Type of compressor		Rotary com-pressor	Rotary com-pressor	Scroll compressor	Scroll compressor
CO ₂ -equivalent (The cooling circuit is hermetically sealed.)	t	0.000016	0.000016	0.000023	0.000023
Airflow					
Max airflow	m ³ /h	2,400	2,950	3,100	3,800
Working area					
Min./max. air temperature, heating	°C	-25 / 38	-25 / 38	-25 / 40	-25 / 40
Min./max. air temperature, cooling	°C	15 / 43	15 / 43	15 / 45	15 / 45
Heating medium circuit					
Max system pressure heating medium	MPa	0.45 (4.5)			
Cut-off pressure, heating medium	MPa	0.25 (2.5)			
Recommended flow interval, heating operation	l/s	0.08 – 0.32	0.12 – 0.48	0.16 – 0.64	0.20 – 0.80
Min. design flow, defrosting (100% pump speed)	l/s	0.32	0.32	0.38	0.48
Min./max. HM temp, continuous operation	°C	26 / 75			
Connection heating medium S2125		G1" external thread			
Connection heating medium flex pipe		G1" external thread	G1" external thread	G1¼" external thread	G1¼" external thread
Min. recommended pipe dimension (system)	DN (mm)	25 (28)	25 (28)	25 (28)	32 (35)
Dimensions and weight					
Width	mm	1,128	1,128	1,278	1,278
Depth	mm	831			
Height	mm	1,080	1,080	1,180	1,180
Weight	kg	179	179	215	215
Miscellaneous					
Part no.		064 219	064 217	064 215	064 213
EPREL no.		2139757	2140404	2146741	2146726

¹ Power statements including defrosting according to EN 14511 at heating medium supply corresponding to DT=5 K at 7 / 45.

² The reported efficiency of the package also takes the controller into account. If an external supplementary boiler or solar heating is added to the package, the overall efficiency of the package should be recalculated.

³ Scale for the product's efficiency class room heating: A+++ to D.. Control module model SMO S.

⁴ Scale for the system's efficiency class room heating: A+++ to G. Reported efficiency for the system takes the product's temperature regulator into account..
Control module model SMO S.

Accessories

Detailed information about the accessories and complete accessories list available at nibe.eu.

Not all accessories are available on all markets.

Energy measurement kit EMK 300

This accessory is installed externally and used to measure the amount of energy that is supplied to the hot water/heating/cooling for the house.

Cu pipe Ø22.

Part no. 067 314



Condensation water pipe KVR

Condensation water pipe, different lengths.

KVR 11-10

1 metres

Part no. 067 823

KVR 11-30

3 metres


Part no. 067 824


KVR 11-60


6 metres

Part no. 067 825









Sustainable energy solutions since 1952

NIBE has been manufacturing energy-efficient and sustainable climate solutions for your home for 70 years. It all began in Markaryd, in the southern Swedish province of Småland, and we recognise our Nordic heritage by utilising the power of nature. We combine renewable energy with smart technology to offer efficient solutions, allowing us to work together to create a more sustainable future.

Regardless of whether it is a chilly winter's day or a warm afternoon in the summer sun, we need a balanced indoor climate that allows us to enjoy a comfortable life, whatever the weather. Our extensive range of products supply your home with cooling, heating, ventilation and hot water, making it possible for you to create a pleasant indoor climate with little impact on the environment.

NIBE Energy Systems
Box 14, SE-285 21 Markaryd
nibe.eu

NIBE

This product sheet is a publication from NIBE Energy Systems. All product illustrations, facts and data are based on current information at the time of the publication's approval. NIBE Energy Systems makes reservations for any factual or printing errors in this product sheet.